

**Moniteau School District
Maintenance Department
Moniteau High School
Monthly Operations Report
Wastewater DMR Test Results
July 2022**



JEFFREY CAMPBELL <jcampbell@moniteau.org>

Your eDMR Report Has Been Received For Permit No. PA0091341

depgreenporthelpdesk@state.pa.us <depgreenporthelpdesk@state.pa.us>
To: jcampbell@moniteau.org, mcafoose92@hotmail.com

Wed, Aug 17, 2022 at 11:51 AM

This email is to confirm that the following report was received by DEP through the eDMR system:

Facility Name: MONITEAU JR SR HIGH SCHOOL
Permit Number: PA0091341
Report Frequency: Monthly
Report Type: DMR
Reporting Period: 07/01/2022-07/31/2022
Report Due Date: 08/28/2022


Submitted By: Jeffrey Campbell
Submission Id: 345381
Submission Status: Received
Submission Type: Original

To view the details of this report, access the eDMR system through DEP's [GreenPort](#) and select the link for View/Revise Submitted.

Moniteau High School Sewage Treatment Plant				Daily Operations Worksheet					
Permit # PA0091341									
Date	Day	#1 PH	#1 DO	#2 PH	#2 DO	Month	Meter Reading	Time	Operator
7/1	Fri	8.21	9.17	8.41	7.83	July	2022	7:00AM	JEFFC
2	SAT								
3	SUN								
4	Mon	Holiday							
5	Tues	8.08	9.16	8.32	8.10	4.8		3:00 AM	JEFFC
6	Wed	8.06	9.15	8.12	8.00	5.0		3:00 AM	JEFFC
7	Thurs	8.00	9.02	8.10	7.95	5.2		10:30 AM	JEFFC
8	Fri	7.95	8.95	8.02	7.93	5.3		10:30 AM	JEFFC
9	SAT								
10	SUN								
11	Mon	7.90	8.70	7.92	7.86	5.8		10:30 AM	JEFFC
12	Tues	7.89	8.68	7.90	7.80	5.6		7:00 AM	JEFFC
13	Wed	7.85	8.56	7.81	7.80	5.8		4:00 PM	JEFFC
14	Thurs	7.82	8.52	7.75	7.77	5.8		8:00 AM	JEFFC
15	Fri	7.77	8.48	7.62	7.79	5.8		1:00 AM	JEFFC
16	SAT								
17	SUN								
18	Mon	7.61	8.37	7.65	7.80	5.8		9:00 AM	JEFFC
19	Tues	7.59	8.32	7.62	7.86	5.8		1:00 AM	JEFFC
20	Wed	7.57	8.23	7.63	7.91	5.8		2:00 AM	JEFFC
21	Thurs	7.42	8.08	7.65	7.80	5.9		7:00 AM	JEFFC
22	Fri	7.40	8.05	7.63	7.85	6.3		7:00 AM	JEFFC
23	SAT								
24	SUN								
25	Mon	AERATION		7.57	7.90	6.3		3:00 AM	JEFFC
26	Tues	7.95	8.08	8.18	8.05	6.3		9:00 AM	JEFFC
27	Wed	8.03	8.19	8.23	8.26	6.0		9:00 AM	JEFFC
28	Thurs	8.11	8.23	8.59	8.43	5.5		9:00 AM	JEFFC
29	Fri	8.22	8.35	8.69	8.55	5.3		9:00 AM	JEFFC
30	SAT								
31	SUN								

* TEST DAY

* TEST DAY

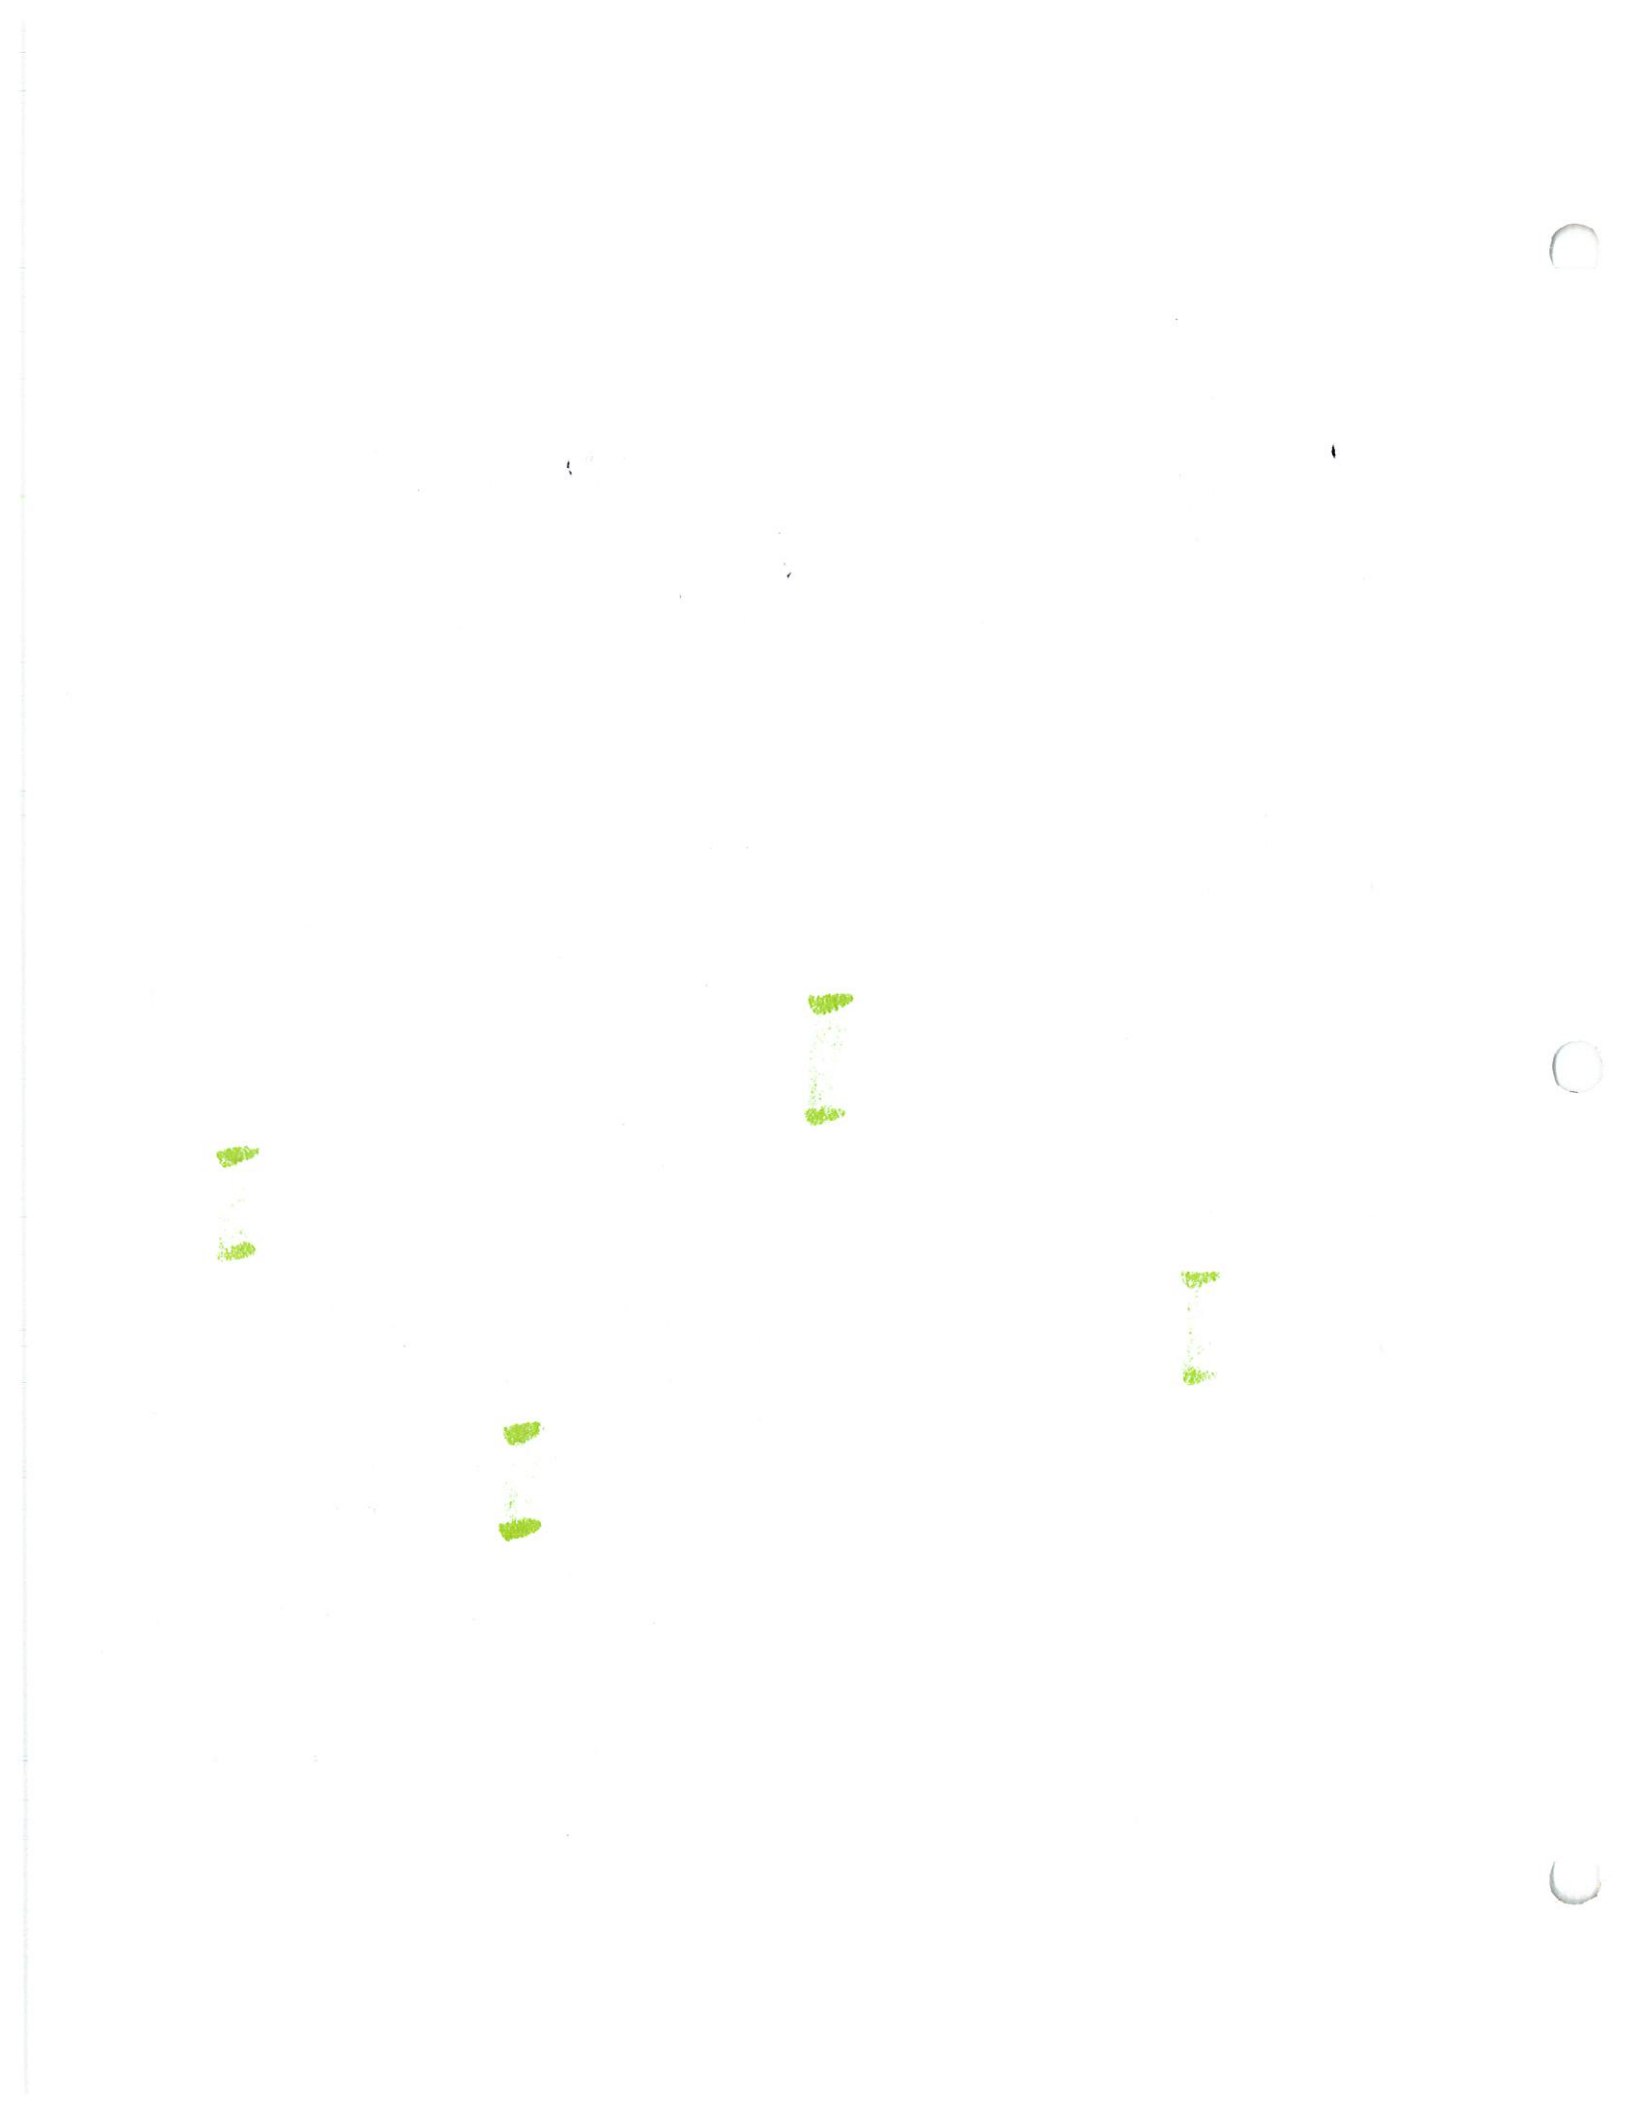

COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF CLEAN WATER

DISCHARGE MONITORING REPORT (DMR)



NAME: MONITEAU SCH DIST
 ADDRESS: 1810 W SUNBURY RD, WEST SUNBURY, PA, 16061-1220
 FACILITY: MONITEAU JR SR HIGH SCHOOL
 LOCATION: 1810 W SUNBURY RD, WEST SUNBURY, PA, 16061-1220
 STAGE: Final Effluent

PA0091341	001
PERMIT NUMBER	OUTFALL NUMBER

MONITORING PERIOD			
YEAR	MO	DAY	TO
2022	07	01	31

Reporting Frequency: Monthly
 DMR Effective From: 07/01/2022
 DMR Effective To: 07/31/2022
 Permit Expires: 05/31/2022
 Permit Application Due: 12/02/2021
 No Discharge:

PARAMETER	SAMPLE MEASUREMENT	QUANTITY OR LOADING		QUANTITY OR CONCENTRATION			SAMPLING FREQUENCY	SAMPLING TYPE
		VALUE	UNITS	VALUE	VALUE	UNITS		
Dissolved Oxygen (00300)	SAMPLE MEASUREMENT	***		7.77	***	***	1/week	Grab
	PERMIT REQUIREMENT	***		4.0	***	***	1/week	Grab
pH (00400)	SAMPLE MEASUREMENT	***		7.40	***	8.69	1/week	Grab
	PERMIT REQUIREMENT	***		6.0	***	9.0 Max	1/week	Grab
Total Suspended Solids (00530)	SAMPLE MEASUREMENT	***		***	***	<5.0	2/month	Grab
	PERMIT REQUIREMENT	***		***	***	30	2/month	Grab
Total Nitrogen (00600)	SAMPLE MEASUREMENT	***		***	***	Avg Mo	2/month	Grab
	PERMIT REQUIREMENT	***		***	***	6.3	2/month	Grab
Total Phosphorus (00665)	SAMPLE MEASUREMENT	***		***	***	Monitor & Report Avg Mo	2/month	Grab
	PERMIT REQUIREMENT	***		***	***	.705	2/month	Grab
Ultraviolet light intensity (49607)	SAMPLE MEASUREMENT	***		***	***	Monitor & Report Avg Mo	2/month	Grab
	PERMIT REQUIREMENT	***		***	***	5.65	1/week	Grab
Flow (50050)	SAMPLE MEASUREMENT	.004546		***	***	Monitor & Report Avg Mo	1/week	Grab
	PERMIT REQUIREMENT	Monitor & Report Avg Mo	MGD	***	***	***	1/week	Measured

COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
BUREAU OF CLEAN WATER

DISCHARGE MONITORING REPORT (DMR)

PARAMETER	QUANTITY OR LOADING		QUANTITY OR CONCENTRATION				SAMPLING FREQUENCY	SAMPLING TYPE
	VALUE	UNITS	VALUE	VALUE	VALUE	UNITS		
Fecal Coliform (74055)	<1.0	<1.0	No./100 ml	2/month	Grab
	200	1000		2/month	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5) (80082)	Geo Mean	IMAX		2/month	Grab
	9.45	...		2/month	Grab
Facility Comments	25	...	mg/L	2/month	Grab
	Avg Mo	...			

COMMENT DETAILS

COMMENTS	OPERATOR NAME	OPERATOR CERTIFICATION NUMBER	OPERATOR CONTACT NUMBER
----------	---------------	-------------------------------	-------------------------

MONITEAU High School

WASTE WATER TREATMENT PLANT

Monthly Operations Report for July 2022

Flow $136,398 \div 30 = 4,546$ Daily Avg.

UV $113 \div 20 = 5.65$ Daily Avg.

PH Low 7.40

High 8.69

D.O. Low 7.77

High 9.26

			Total	Avg.
TOTAL Nitrogen	10.7	1.91	12.61	6.3
TSS	<5	<5	<5	<5
TKN	<0.625	0.993	1.618	0.809
Nitrate / Nitrite	10.7	0.917	11.617	5.808
Phosphorus	1.2	0.21	1.41	0.705
CBOD	15.9	<3.00	18.9	9.45
Fecal	1	<1	1	<1

1. $1000 \times 1.05 = 1050$
 2. $1050 \times 1.05 = 1102.5$
 3. $1102.5 \times 1.05 = 1157.625$

4. $1157.625 \times 1.05 = 1215.50625$
 5. $1215.50625 \times 1.05 = 1276.2815625$

6. $1276.2815625 \times 1.05 = 1340.095640625$
 7. $1340.095640625 \times 1.05 = 1407.10042265625$
 8. $1407.10042265625 \times 1.05 = 1477.4554437890625$

Year	Initial Investment	Interest	Total	Final Value
1	1000	50	1050	1050
2	1050	52.5	1102.5	1102.5
3	1102.5	55.625	1157.625	1157.625
4	1157.625	59.5375	1215.50625	1215.50625
5	1215.50625	63.8728125	1276.2815625	1276.2815625
6	1276.2815625	68.975284375	1340.095640625	1340.095640625
7	1340.095640625	74.605038125	1407.10042265625	1407.10042265625
8	1407.10042265625	80.361526378125	1477.4554437890625	1477.4554437890625



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

02 August 2022

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 22G2191
Project: Wastewater
Project Description: Wastewater

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
Effluent Grab Outfall 001	22G2191-01	Waste Water	07/21/2022 11:30	7/21/22 14:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

- Qq Matrix Spike Duplicate analysis did not meet laboratory acceptance criteria.
- RL Reporting Limit
- CFU Colony Forming Units

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.
 Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Kirsten Conoran

Kirsten Conoran
 Project Manager





1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 08/02/2022 08:25

Lab Sample ID#: 22G2191-01
Sample Type: Waste Water
Sample Source: Grab
Sampler: Client
Client Sample ID: Effluent Grab Outfall 001

Sample Date: 07/21/2022 11:30
Receipt Date: 07/21/2022 14:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
General Chemistry	Analytical Method: CALC				Prep Method: [CALC]		
Total Nitrogen	1.91	mg/L		0.729	DAA	07/27/22 06:30	07/28/22 15:15
General Chemistry	Analytical Method: SM2540 D-11				Prep Method: No Prep - WetChem		
Total Suspended Solids	<5	mg/L		5	LMB	07/28/22 14:45	07/28/22 14:45
General Chemistry	Analytical Method: SM4500 NH3 F-11				Prep Method: SM 4500-Norg B		
Total Kjeldahl Nitrogen	0.993	mg/L	Qq	0.625	DAA	07/27/22 06:30	07/28/22 15:15
General Chemistry	Analytical Method: SM4500-NO3 E-11 (discrete)				Prep Method: No Prep - WetChem		
Nitrate/Nitrite	0.917	mg/L		0.104	AW	07/26/22 11:57	07/26/22 11:57
General Chemistry	Analytical Method: SM4500-P E-11				Prep Method: No Prep - WetChem		
Phosphorus	0.21	mg/L		0.10	AW	07/28/22 12:20	07/28/22 12:20
General Chemistry	Analytical Method: SM5210 B-11				Prep Method: No Prep - WetChem		
Carbonaceous Biochemical Oxygen Demand	<3.00	mg/L		3.00	TJC	07/22/22 13:10	07/27/22 09:27
Microbiology	Analytical Method: Colilert-18				Prep Method: No Prep - Micro		
Fecal Coliforms	<1	MPN/100 mL		1	AMB	07/21/22 14:54	07/22/22 12:26



SAMPLE RECEIPT AND REVIEW FORM

Client: <u>Moniteau S.D.</u>	Work Order: 22G2191
-------------------------------------	-------------------------------

PART A: GENERAL INFORMATION- SATELLITE LABORATORY

Received by/Lab ID: _____	Date/Time Received: <u> / / </u>
Method of Delivery: Client Drop-Off <input type="checkbox"/> ESL Courier <input type="checkbox"/> Other: _____	
Sample Receipt Temperature: _____ °C	Received on Ice? YES <input type="checkbox"/> NO <input type="checkbox"/>
Containers Removed by Satellite Lab for Analysis of: FECAL <input type="checkbox"/> TC/EC <input type="checkbox"/> TC MPN <input type="checkbox"/> EC MPN <input type="checkbox"/> TC/EC MPN <input type="checkbox"/> N/A <input type="checkbox"/>	

PART B: GENERAL INFORMATION- INDIANA LABORATORY

Received by/Lab ID: <u>AK/00382</u>	Samples Received on Ice? YES <input checked="" type="checkbox"/> NO <input type="checkbox"/>
Date/Time Received: <u>7/21/22 1430</u>	Date Sampled: <u>7/21/22</u>
Method of Delivery: FedEx <input type="checkbox"/> UPS <input type="checkbox"/> Client Drop off <input type="checkbox"/> <u>ESL courier</u> <input checked="" type="checkbox"/> Other: _____	
Sample Receipt Temperature: <u>5.1</u> °C	IR Gun ID: <u>3</u>
Sample State of Collection: <u>PA</u> NY <input type="checkbox"/> OH <input type="checkbox"/> WV <input type="checkbox"/> Other: _____	PWSID Compliance Drinking Water Samples: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>

PART C: Receipt Details Completed (if different from above): _____

Sample Receipt Criteria			Comments/Qualifiers (Required for Non-Conforming Items)	Signature _____	Date <u> / / </u>	Time _____
Chain of custody documents included with samples?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Comments:			
COC form is properly signed in relinquished/received sections?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Comments:			
Sample containers intact and sealed?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Circle Applicable: Damaged Container <input type="checkbox"/> Leaking Container <input type="checkbox"/> Custody Seal Broken <input type="checkbox"/> Other: _____			
Number of containers received matches number indicated on COC?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Sample IDs and Containers Affected:			
Sample IDs on COC match IDs on bottles?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Sample IDs and Containers Affected:			
Date and time on COC match date and time on bottles?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Sample IDs and Containers Affected:			
Samples received within holding time?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Sample IDs and Containers Affected:			
Samples received at appropriate pH for analysis requested?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Sample IDs and Containers Affected and Observed pH:			
Samples requiring thermal preservation within 0 ≤ 6°C? Microbiology within 0 ≤ 10°C?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	For non-WV samples outside of thermal preservation range sampled same day and received on ice are considered acceptable as long as the cooling process has begun.			
Adequate sample volume received?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Analyses Affected:			
VOA vials free of headspace (defined as < 6 mm bubble)?	YES <input checked="" type="checkbox"/>	NO <input type="checkbox"/>	Sample IDs and Containers Affected:			
Other Comments: _____				Deficiency Log Created: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		

Effective Date: _____



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

21 July 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22G0607
Project: Wastewater
Project Description: Wastewater

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
Effluent Grab Outfall 001	22G0607-01	Waste Water	07/07/2022 10:30	7/7/22 15:45	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

- MH Matrix Spike recovery exceeded the laboratory acceptance criteria; result may be biased high.
- G CBOD / BOD result may be biased low due to GGA standard falling below laboratory acceptance criteria.
- RL Reporting Limit
- CFU Colony Forming Units

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.
Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Kirsten Conoran

Kirsten Conoran
Project Manager





1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 07/21/2022 11:49

Lab Sample ID#: 22G0607-01
Sample Type: Waste Water
Sample Source: Grab
Sampler: Client
Client Sample ID: Effluent Grab Outfall 001

Sample Date: 07/07/2022 10:30
Receipt Date: 07/07/2022 15:45

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
General Chemistry	Analytical Method: CALC				Prep Method: [CALC]		
Total Nitrogen	10.7	mg/L		1.66	DAA	07/15/22 11:09	07/15/22 11:09
General Chemistry	Analytical Method: SM2540 D-11				Prep Method: No Prep - WetChem		
Total Suspended Solids	<5	mg/L		5	LMB	07/14/22 11:48	07/14/22 13:00
General Chemistry	Analytical Method: SM4500 NH3 F-11				Prep Method: SM 4500-Norg B		
Total Kjeldahl Nitrogen	<0.625	mg/L		0.625	DAA	07/14/22 06:50	07/14/22 11:52
General Chemistry	Analytical Method: SM4500-NO3 E-11 (discrete)				Prep Method: No Prep - WetChem		
Nitrate/Nitrite	10.7	mg/L	MH	1.04	AW	07/15/22 11:09	07/15/22 11:09
General Chemistry	Analytical Method: SM4500-P E-11				Prep Method: No Prep - WetChem		
Phosphorus	1.2	mg/L		0.50	AW	07/20/22 13:30	07/20/22 13:30
General Chemistry	Analytical Method: SM5210 B-11				Prep Method: No Prep - WetChem		
Carbonaceous Biochemical Oxygen Demand	15.9	mg/L	G	6.00	MJS	07/08/22 16:24	07/13/22 14:16
Microbiology	Analytical Method: Colilert-18				Prep Method: No Prep - Micro		
Fecal Coliforms	1	MPN/100 mL		1	DAA	07/07/22 15:35	07/08/22 13:00

ENVIRONMENTAL SERVICE LABORATORIES, I

HEADQUARTERS
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN I
1276 Bentley
Van Voorhis, I
(724) 258-TEST
FAX: (724) 258-8376

22G0607



NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16150
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESI#	Sample Type		Matrix	# of Containers	Container Type Preservative	Analysis Requested
		Composite	Grab				
		Date on/off	Time on/off	Date	Time		
Effluent Outfall 001	01			7/7/22	10:30 AM	Poly 1000mL None	CBOD, TSS
						Poly 1000mL H2SO4	Total Nitrogen, Total Phosphorus
						Sterile Plastic 125mL Na2S2O3	Fecal Coliform

Project Notes: **Wastewater**

Company/Name: **MONITEAU SCHOOL DISTRICT**

Contact Person: **JEFFREY CAMPBELL**

Address: **1810 WEST SUNBURY ROAD
WEST SUNBURY, PA 16061
724-406-4426
jcampbell@moniteau.org**


Received By: (Signature) [Signature] Date/Time: 7/7/22 10:30 AM

Relinquished By: (Signature) [Signature] Date/Time: 7/7/22 10:30 AM

Correct Containers Y/N/NA: Y/N/NA Receipt Temperature: _____

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.
1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW).
2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

SAMPLE RECEIPT AND REVIEW FORM

Client: Moniteau School District Work:  22G0607

PART A: GENERAL INFORMATION- SATELLITE LABORATORY

Received by/Lab ID: _____ Date/Time Received: / /
 Method of Delivery: Client Drop-Off ESL Courier Other: _____ Received on Ice? YES NO
 Sample Receipt Temperature: _____ °C IR Gun ID: _____
 Containers Removed by Satellite Lab for Analysis of: FECAI TC/EC TC MPN EC MPN TC/EC MPN N/A

PART B: GENERAL INFORMATION- INDIANA LABORATORY

Received by/Lab ID: SPM 00383 Samples Received on Ice? YES NO
 Date/Time Received: 71 7 12 1545 Date Sampled: 717122
 Method of Delivery: FedEx UPS Client Drop off ESL courier Other: _____
 Sample Receipt Temperature: 3.2 °C IR Gun ID: 3
 Sample State of Collection: PA NY OH WV Other: _____ PWSID Compliance Drinking Water Samples: YES NO

PART C: Receipt Details Completed (if different from above): _____

Sample Receipt Criteria	YES	NO	Comments/Qualifiers (Required for Non-Conforming Items)
Chain of custody documents included with samples?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments: _____
COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Comments: _____
Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Circle Applicable: Damaged Container <input type="checkbox"/> Custody Seal Broken <input type="checkbox"/> Other <input type="checkbox"/> Leaking Container <input type="checkbox"/>
Number of containers received matches number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample IDs and Containers Affected: _____
Sample IDs on COC match IDs on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample IDs and Containers Affected: _____
Date and time on COC match date and time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample IDs and Containers Affected: _____
Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample IDs and Containers Affected: _____
Samples received at appropriate pH for analysis requested?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample IDs and Containers Affected and Observed pH: _____
Samples requiring thermal preservation within 0 ≤ 6°C? Microbiology within 0 ≤ 10°C?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	For non-WV samples outside of thermal preservation range sampled same day and received on ice are considered acceptable as long as the cooling process has begun.
Adequate sample volume received?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Analyses Affected: _____
VOA vials free of headspace (defined as < 6 mm bubble)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Sample IDs and Containers Affected: _____
Other Comments: _____			Deficiency Log Created: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>

Effective Date: _____

Moniteau School District
Food Service Department
Memo
7/25/2022

To: Susan Kirschner
From: Carrie Plecher
Re: Sponsor Agreement

Good Afternoon,

I would like this Sponsor agreement to be presented to the Board for approval for the 2022-2023 school year.

Thank you!

Carrie Plecher
Director of Food Services

**Moniteau School District
Maintenance Department
Moniteau High School
Monthly Operations Report
Water Quality Test Results
July 2022**

MONTH		MONITEAU HIGH SCHOOL WATER TREATMENT PLANT									
DAY	TEMP	July 2022	METER READING	CL2 FREE	CL2 TOTAL	PH	IRON	MAG.	HARDNESS	OPERATOR	TIME
1	Fri										
2	SAT										
3	SUN										
4	Mon										
5	Tues	72.0	6,747,216	0.55	0.65	7.1	0.02	0	1.58	JEFF C	3:30 PM
6	Wed	72.0	6,747,216	0.55	0.64	7.1	0.02	0	1.60	JEFF C	4:00 PM
7	Thurs	65.9	6,752,418	0.54	0.63	7.1	0.02	0	1.59	JEFF C	11:00 AM
8	Fri										
9	SAT										
10	SUN										
11	Mon	67.0	6,766,095	0.69	0.74	7.1	0.00	0	1.12	JEFF C	11:00 AM
12	Tues	70.0	6,766,095	0.69	0.75	7.1	0.00	0	1.11	JEFF C	4:00 PM
13	Wed	71.0	6,787,640	0.65	0.71	7.1	0.00	0	1.02	JEFF C	3:00 PM
14	Thurs	72.0	6,787,640	0.65	0.70	7.1	0.00	0	1.01	JEFF C	4:00 AM
15	Fri										
16	SAT										
17	SUN										
18	Mon	67.0	6,863,030	0.55	0.65	7.0	0.02	0	1.29	JEFF C	2:00 AM
19	Tues	74.0	6,863,030	0.53	0.62	7.0	0.02	0	1.27	JEFF C	7:00 AM
20	Wed	77.0	6,863,030	0.52	0.60	7.0	0.02	0	1.27	JEFF C	10:00 AM
21	Thurs	78.0	6,863,030	0.52	0.59	7.0	0.02	0	1.25	JEFF C	8:00 AM
22	Fri										
23	SAT										
24	SUN										
25	Mon	77.0	6,874,396	0.55	0.62	7.0	0.00	0	1.10	JEFF C	8:00 AM
26	Tues	78.1	6,874,396	0.56	0.62	7.0	0.00	0	1.11	JEFF C	7:00 PM
27	Wed	78.5	6,874,396	0.55	0.61	7.0	0.00	0	1.08	JEFF C	4:00 PM
28	Thurs	67.1	6,883,614	0.62	0.70	7.0	0.00	0	0.87	JEFF C	5:00 PM
29	Fri										
30	SAT										
31											

METER READING 6/30/22 6,739,097

WATER TEST

SEWAGE TEST





1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

14 July 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22G0693
Project: Drinking Water Moniteau Jr/Sr - Monthly 704
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
704 Kitchen Main Sink	22G0693-01	Drinking Water	07/07/2022 12:30	7/7/22 15:05	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.
Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Kirsten Conoran

Kirsten Conoran
Project Manager





1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 07/14/2022 10:09

Lab Sample ID#: 22G0693-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 704 Kitchen Main Sink

Sample Date: 07/07/2022 12:30
Receipt Date: 07/07/2022 15:05

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field		
Chlorine, Free	0.690	mg/L		0.200	PS	07/07/22 12:30	07/07/22 12:30
Microbiology	Analytical Method: SM9223 B-04				Prep Method: No Prep - Micro		
Total Coliform	Absent	per 100 mL		1	DAA	07/07/22 16:05	07/08/22 18:30
E. Coli	Absent	per 100 mL		1	DAA	07/07/22 16:05	07/08/22 18:30

This sample MEETS current EPA and DEP bacteriological standards of no detectable coliform bacteria per 100 mL sample.

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376

NORTHERN DIVISION
435 Broad Street
Montoursville, PA 17754
(570) 321-9003
FAX: (570) 321-1957

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16150
(724) 463-TEST
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY

SAMPLE REQUEST & CHAIN OF CUSTODY



Sample Identification CIRCLE ONE: 704 KITCHEN MAIN SINK 802-ROOM 204 SINK		ESL# 22G-0693 01	Sample Type Date: 7-7-20 Time: 1230	Matrix DW	# of Bottles 1	Container Type Preservative STERILE PLASTIC NA THIO	Analysis Requested TC/EC Free Chlorine .69
THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.							
1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)							
2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.							
Sampled By: (Signature)		Date/ Time 7-7-20 1230		Received By: (Signature)		Date/ Time 7-7-20 1505	
Relinquished By: (Signature)		Date/ Time		Received By: (Signature)		Date/ Time	
Relinquished By: (Signature)		Date/ Time		Received By: (Signature)		Date/ Time	
Relinquished By: (Signature)		Date/ Time		Received By: (Signature)		Date/ Time	
Correct Preservations Y/N/NA		Correct Containers Y/N/NA		Receipt Temperature		Receipt Temperature	
Notes/Special Instructions: Drinking Water Moniteau Jr/Sr - Monthly							
Company/Name: MONITEAU SCHOOL DISTRICT Address: 1810 WEST SUNBURY ROAD WEST SUNBURY, PA 16061 Contact Person: JEFFREY CAMPBELL Phone Number: 724-406-4426 Cell Phone: jcampbell@moniteau.org Email Address: jcampbell@moniteau.org Billing Address: PWSID: 5100324							



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.69	070722	704		070722	D	1230	32382	22G0693-01	BROWNKA_227
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	704		070722	D	1230	32382	22G0693-01	BROWNKA_228



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

15 July 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22G1496
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
802 Room 204 Sink	22G1496-01	Drinking Water	07/14/2022 11:30	7/14/22 17:00	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Kirsten Conoran

Kirsten Conoran
Project Manager



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 07/15/2022 16:29

Lab Sample ID#: 22G1496-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 802 Room 204 Sink

Sample Date: 07/14/2022 11:30
Receipt Date: 07/14/2022 17:00

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11		Prep Method: No Prep - Field				
Chlorine, Free	0.790	mg/L		0.200	PS	07/14/22 11:30	07/14/22 11:30

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15386
(724) 258-TEST
FAX: (724) 258-8376



22G1496

NORTHWEST DIVISION
950 Main Street
Sharpshville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

SE 1 OF 1

Sample Identification		ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
Distribution: <u>888</u>		<u>2261496</u>	Date	Grab	DW	Field	Preservative	Free Chlorine <u>.79</u> mg/L
		<u>01</u>	<u>7/4/27</u>	<u>1130</u>				
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>								
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p> <p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>								
<p>Notes/Special Instructions:</p> <p><i>Drinking Water Moniteau Jr/Sr - Weekly</i></p>			<p>Company/Name: MONITEAU SCHOOL DISTRICT</p> <p>Address: 391 HOOKER ROAD WEST SUNBURY, PA 16061 JEFFREY CAMPBELL</p> <p>Contact Person: 724-406-4426 jcampbell@moniteau.org</p> <p>Phone Number: 5100324</p> <p>Cell Phone:</p> <p>Email Address:</p> <p>Billing Address:</p> <p>PWSID:</p>					
<p>Sampled By: (Signature) <u>[Signature]</u> <u>7-4-27</u> <u>1130</u> Date/ Time</p> <p>Relinquished By: (Signature) <u>[Signature]</u> <u>7-4-27</u> <u>1300</u> Date/ Time</p> <p>Relinquished By: (Signature) _____ Date/ Time</p> <p>Relinquished By: (Signature) _____ Date/ Time</p>			<p>Received By: (Signature) <u>[Signature]</u> <u>7/14/27</u> <u>1700</u> Date/ Time</p> <p>Received By: (Signature) _____ Date/ Time</p> <p>Received By: (Signature) _____ Date/ Time</p>					
<p>Correct Preservations Y / N / NA</p>			<p>Correct Containers Y / N / NA</p> <p>Receipt Temperature _____</p>					



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.69	070722	704		070722	D	1230	32382	22G0693-01	BROWNKA_227
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	704		070722	D	1230	32382	22G0693-01	BROWNKA_228
5100324	1013	FREE CHLORINE	301	0.79	071422	802		071422	D	1130	32382	22G1496-01	BROWNKA_813



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

25 July 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22G2282
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
803 Admin Sink	22G2282-01	Drinking Water	07/21/2022 11:18	7/21/22 14:14	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Kirsten Conoran

Kirsten Conoran
Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 600
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 07/25/2022 11:00

Lab Sample ID#: 22G2282-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 803 Admin Sink

Sample Date: 07/21/2022 11:18
Receipt Date: 07/21/2022 14:14

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11		Prep Method: No Prep - Field				
Chlorine, Free	0.560	mg/L		0.200	PS	07/21/22 11:18	07/21/22 11:18

ENVIRONMENTAL SERVICE LABORATORIES, INC

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Roa
Van Voorhis, PA 1536
(724) 258-TEST
FAX: (724) 258-8376

22G2282



NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPI F REQUEST & CHAIN OF CUSTODY

BE ___1___ OF ___1___

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Date	Time				
Distribution: 803	22G2282	7/21/07	1118	DW	Field	Field	Free Chlorine - 56 mg/L
<div style="border: 1px solid black; padding: 5px;"> <p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin-Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p> </div>							
<p>Notes/Special Instructions: Drinking Water Moniteau Jr/Sr - Weekly</p>							
<p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW).</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>				<p>Company/Name: MONITEAU SCHOOL DISTRICT</p> <p>Address: 391 HOOKER ROAD WEST SUNBURY, PA 16061 JEFFREY CAMPBELL</p> <p>Contact Person: JEFFREY CAMPBELL</p> <p>Phone Number: 724-406-4426</p> <p>Cell Phone: jcampbell@moniteau.org</p> <p>Billing Address: 5100324</p> <p>PWSID: 5100324</p>			
<p>Sampled By: (Signature) <i>[Signature]</i></p> <p>Date/ Time: 7/21/07 1118</p>		<p>Received By: (Signature) <i>[Signature]</i></p> <p>Date/ Time: 7/21/07 1414</p>		<p>Relinquished By: (Signature) <i>[Signature]</i></p> <p>Date/ Time: 7/21/07 1414</p>		<p>Received By: (Signature)</p> <p>Date/ Time</p>	
<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>		<p>Received By: (Signature)</p> <p>Date/ Time</p>		<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>		<p>Received By: (Signature)</p> <p>Date/ Time</p>	
<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>		<p>Received By: (Signature)</p> <p>Date/ Time</p>		<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>		<p>Received By: (Signature)</p> <p>Date/ Time</p>	
<p>Correct Preservations 0 / N / NA</p>		<p>Correct Containers 0 / N / NA</p>		<p>Receipt Temperature 34.4</p>		<p><i>[Signature]</i> 7/21/07</p>	



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.69	070722	704		070722	D	1230	32382	22G0693-01	BROWNKA_227
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	704		070722	D	1230	32382	22G0693-01	BROWNKA_228
5100324	1013	FREE CHLORINE	301	0.79	071422	802		071422	D	1130	32382	22G1496-01	BROWNKA_813
5100324	1013	FREE CHLORINE	301	0.56	072122	803		072122	D	1118	32382	22G2282-01	BROWNKA_2098



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 07/29/2022 11:55

Lab Sample ID#: 22G2889-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Vance Byram
Client Sample ID: 804 400 Hall RR Sink

Sample Date: 07/28/2022 09:50
Receipt Date: 07/28/2022 14:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis							
Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field			
Chlorine, Free	<0.200	mg/L		0.200	VB	07/28/22 09:50	07/28/22 09:50

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISI
1276 Bentleyville R
Van Voorhis, PA 15
(724) 258-TEST
FAX: (724) 258-8

NORTHERN DIVISION
22G2889

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

Page 3 of 4

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Date	Time				
Distribution: 804	262889	07/28/12	0950	DW	Field	Field	Free Chlorine 0.09 mg/L
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>							
<p>Notes/Special Instructions::</p> <p>Drinking Water Moniteau Jr/Sr - Weekly</p>							
<p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1/12% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>				<p>Company/Name: MONITEAU SCHOOL DISTRICT</p> <p>Address: 391 HOOKER ROAD WEST SUNBURY, PA 16061 JEFFREY CAMPBELL</p> <p>Contact Person: 724-406-4426 Phone Number: jcampbell@moniteau.org Cell Phone: 5100324 Email Address: Billing Address: PWSID:</p>			
<p>Received By: (Signature)</p> <p>Received By: (Signature)</p> <p>Received By: (Signature)</p>		<p>Date/ Time</p> <p>Date/ Time</p> <p>Date/ Time</p>		<p>Received By: (Signature)</p> <p>Received By: (Signature)</p> <p>Received By: (Signature)</p>		<p>Date/ Time</p> <p>Date/ Time</p> <p>Date/ Time</p>	
<p>Correct Preservations Y / N / NA</p>		<p>Correct Containers Y / N / NA</p>		<p>Receipt Temperature</p>			



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.69	070722	704		070722	D	1230	32382	22G0693-01	BROWNKA_227
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	704		070722	D	1230	32382	22G0693-01	BROWNKA_228
5100324	1013	FREE CHLORINE	301	0.79	071422	802		071422	D	1130	32382	22G1496-01	BROWNKA_813
5100324	1013	FREE CHLORINE	301	0.56	072122	803		072122	D	1118	32382	22G2282-01	BROWNKA_2098
5100324	1013	FREE CHLORINE	301	0.09	072822	804		072822	D	0950	32382	22G2889-01	BROWNKA_2440



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

08 August 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22H0686
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 400 Hall RR Sink	22H0686-01	Drinking Water	07/28/2022 17:00	8/5/22 10:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Shane Molyneaux
Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 08/08/2022 11:33

Lab Sample ID#: 22H0686-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Client
Client Sample ID: 804 400 Hall RR Sink

Sample Date: 07/28/2022 17:00
Receipt Date: 08/05/2022 10:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis							
Chlorine, Free	0.620	mg/L			Client	07/28/22 17:00	07/28/22 17:00

SAMPLE REQUEST & CHAIN OF CUSTODY

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4218

SOUTHERN DIVISION
1276 Brentleyville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376

NORTHERN DIVISION
435 Broad Street
Monroeville, PA 17154
(570) 321-9003
FAX: (570) 321-1957

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY



22H0686

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Date	Time				
Distribution: 804	22H0686	7/28/22	5:00 PM	DW	Field	Field	Free Chlorine <i>O. Cat</i> mg/L
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>							

Notes/Special Instructions: **Drinking Water Moniteau Jr/Sr - Weekly**

Company/Name: **MONITEAU SCHOOL DISTRICT**

Address: **391 HOOKER ROAD
WEST SUNBURY, PA 16061**

Contact Person: **JEFFREY CAMPBELL**

Phone Number: **724-406-4426**

Call Phone: **jcambell@moniteau.org**

Email Address: **jcambell@moniteau.org**

Billing Address: **5100324**

PW/SID:

Received By: (Signature) *[Signature]* Date/ Time **8-4-22 1135**

Relinquished By: (Signature) *[Signature]* Date/ Time **8-4-22 1450**

Received By: (Signature) *[Signature]* Date/ Time **8-5-22 1030**

Relinquished By: (Signature) *[Signature]* Date/ Time **6.3**

Correct Preservations Y / N / NA

Correct Containers Y / N / NA

Receipt Temperature

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1.12% PER MONTH (13% PER ANNUM) OR THE MAXIMUM ALLOWED BY LAW.

2. THE UNDERSIGNED PURCHASER AGREES TO PAY IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100324: MONITEAU JR/SR HIGH SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.69	070722	704		070722	D	1230	32382	22G0693-01	BROWNKA_227
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	704		070722	D	1230	32382	22G0693-01	BROWNKA_228
5100324	1013	FREE CHLORINE	301	0.79	071422	802		071422	D	1130	32382	22G1496-01	BROWNKA_813
5100324	1013	FREE CHLORINE	301	0.56	072122	803		072122	D	1118	32382	22G2282-01	BROWNKA_2098
5100324	1013	FREE CHLORINE	301	0.09	072822	804		072822	D	0950	32382	22G2889-01	BROWNKA_2440
5100324	1013	FREE CHLORINE	301	0.62	072822	804		072822	D	1700	32382	22H0686-01	BROWNKA_2766

**Moniteau School District
Maintenance Department
Dassa McKinney Elem. School
Monthly Operations Report
Water Quality Test Results
July 2022**



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

14 July 2022

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 22G0695
Project: Drinking Water Dassa McKinney - Monthly 801
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
801 Kitchen Sink	22G0695-01	Drinking Water	07/07/2022 12:15	7/7/22 15:05	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By

Kirsten Conoran

Kirsten Conoran
 Project Manager





1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 07/14/2022 10:10

Lab Sample ID#: 22G0695-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 801 Kitchen Sink

Sample Date: 07/07/2022 12:15
Receipt Date: 07/07/2022 15:05

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field		
Chlorine, Free	0.930	mg/L		0.200	PS	07/07/22 12:15	07/07/22 12:15
Microbiology	Analytical Method: SM9223 B-04				Prep Method: No Prep - Micro		
Total Coliform	Absent	per 100 mL		1	DAA	07/07/22 16:05	07/08/22 18:30
E. Coli	Absent	per 100 mL		1	DAA	07/07/22 16:05	07/08/22 18:30

This sample MEETS current EPA and DEP bacteriological standards of no detectable coliform bacteria per 100 mL sample.

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376

NORTHERN DIVISION
435 Broad Street
Montoursville, PA 17754
(570) 321-9003
FAX: (570) 321-1957

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

Page 3 of 4



FOR INTERNAL LABORATORY USE ONLY

Sample Identification 801 KITCHEN SINK 802 ROOM 617 SINK	ESL# 22G0695	Matrix DW	# of Bottles 1	Container Type STERILE PLASTIC NA THIO	Analysis Requested TC/EC Free Chlorine .93 mg/L
	Date 7-7-02	Time 12:15			

Sampled By: (Signature) Date/ Time 7-7-02 12:15	Received By: (Signature) Date/ Time 7-7-02 12:15
Relinquished By: (Signature) Date/ Time 7-7-02 12:15	Received By: (Signature) Date/ Time
Relinquished By: (Signature) Date/ Time	Received By: (Signature) Date/ Time
Relinquished By: (Signature) Date/ Time	Received By: (Signature) Date/ Time

Correct Preservations Y/N / NA	Correct Containers Y/N / NA	Receipt Temperature 44.1 F
-----------------------------------	--------------------------------	-------------------------------

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM) OR THE MAXIMUM ALLOWED BY LAW;

2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Notes/Special Instructions:
 Drinking Water Dassa McKinney - Monthly

Company/Name: MONTEAU SCHOOL DISTRICT
 Address: 391 HOOKER ROAD
 WEST SUNBURY, PA 16061
 JEFFREY CAMPBELL
 Contact Person: 724-406-4426
 Phone Number: jcampbell@monteau.org
 Cell Phone: 5100316
 Email Address:
 Billing Address:
 PWSID:



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.93	070722	801		070722	D	1215	32382	22G0695-01	BROWNKA_225
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	801		070722	D	1215	32382	22G0695-01	BROWNKA_226



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

15 July 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22G1495
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
802 Room 617 Sink	22G1495-01	Drinking Water	07/14/2022 11:15	7/14/22 17:00	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Kirsten Conoran

Kirsten Conoran
Project Manager



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 07/15/2022 16:29

Lab Sample ID#: 22G1495-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 802 Room 617 Sink

Sample Date: 07/14/2022 11:15
Receipt Date: 07/14/2022 17:00

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11		Prep Method: No Prep - Field				
Chlorine, Free	0.660	mg/L		0.200	PS	07/14/22 11:15	07/14/22 11:15

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Bentleyville Road
Van Voorhis, PA 15386
(724) 258-TEST
FAX: (724) 258-8376



NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY

RE 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Date	Time				
Distribution: <u>806</u>	<u>22G1495</u>	<u>7/14/22</u>	<u>1115</u>	DW	Field	Field	Free Chlorine <u>..666</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room 606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>							
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p> <p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1.12% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>							
<p>Sampled By: (Signature) <u>[Signature]</u></p> <p>Date/ Time <u>7/14/22 1115</u></p>				<p>Received By: (Signature) <u>[Signature]</u></p> <p>Date/ Time <u>7/14/22 1730</u></p>			
<p>Relinquished By: (Signature) _____</p> <p>Date/ Time _____</p>				<p>Received By: (Signature) _____</p> <p>Date/ Time _____</p>			
<p>Relinquished By: (Signature) _____</p> <p>Date/ Time _____</p>				<p>Received By: (Signature) _____</p> <p>Date/ Time _____</p>			
<p>Relinquished By: (Signature) _____</p> <p>Date/ Time _____</p>				<p>Received By: (Signature) _____</p> <p>Date/ Time _____</p>			
<p>Correct Preservations Y / N / NA</p>				<p>Correct Containers Y / N / NA</p>			
<p>Receipt Temperature _____</p>				<p>Company/Name: MONITEAU SCHOOL DISTRICT</p> <p>Address: 391 HOOKER ROAD</p> <p>WEST SUNBURY, PA 16061</p> <p>Contact Person: JEFFREY CAMPBELL</p> <p>Phone Number: 724-406-4426</p> <p>Cell Phone: icampbell@moniteau.org</p> <p>Billing Address: 5100316</p> <p>PWSID: _____</p>			
<p>Notes/Special Instructions: Drinking Water Dassa McKinney - Weekly</p>							



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.93	070722	801		070722	D	1215	32382	22G0695-01	BROWNKA_225
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	801		070722	D	1215	32382	22G0695-01	BROWNKA_226
5100316	1013	FREE CHLORINE	301	0.66	071422	802		071422	D	1115	32382	22G1495-01	BROWNKA_812



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

25 July 2022

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 22G2281
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
803 Room 606 Sink	22G2281-01	Drinking Water	07/21/2022 11:00	7/21/22 14:14	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Kirsten Conoran

Kirsten Conoran
 Project Manager



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 07/25/2022 11:00

Lab Sample ID#: 22G2281-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Paul Somogyi
Client Sample ID: 803 Room 606 Sink

Sample Date: 07/21/2022 11:00
Receipt Date: 07/21/2022 14:14

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field		
Chlorine, Free	0.620	mg/L		0.200	PS	07/21/22 11:00	07/21/22 11:00

ENVIRONMENTAL SERVICE LABORATORIES, J

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE

SOUTHERN DIVISION
1276 Bentleyville R
Van Voorhis, PA 151
(724) 258-TEST
FAX: (724) 258-8376

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

#E 1 OF 1

Sample Identification	ESL#	Sample Type	Matrix	# of Bottles	Container Type	Analysis Requested
Distribution: <u>SOS</u>	<u>22G2281</u>	Date: <u>7/27/07</u> Time: <u>1100</u>	DW	Field	Field	Free Chlorine <u>.62</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room 606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>						
<p>Notes/Special Instructions:</p> <p style="text-align: center;"><i>Drinking Water Dassa McKinney - Weekly</i></p>						
<p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1.12% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>						
Sampled By: (Signature) <u>[Signature]</u> Date/Time: <u>07/27/07</u>		Received By: (Signature) <u>[Signature]</u> Date/Time: <u>7/27/07 11:44</u>		Company/Name: MONITEAU SCHOOL DISTRICT		
Relinquished By: (Signature) <u>[Signature]</u> Date/Time: <u>07/27/07</u>		Received By: (Signature) <u>[Signature]</u> Date/Time: <u>7/27/07</u>		Address: 391 HOOKER ROAD		
Relinquished By: (Signature) <u>[Signature]</u> Date/Time: <u>07/27/07</u>		Received By: (Signature) <u>[Signature]</u> Date/Time: <u>7/27/07</u>		Contact Person: WEST SUNBURY, PA 16061		
Relinquished By: (Signature) <u>[Signature]</u> Date/Time: <u>07/27/07</u>		Received By: (Signature) <u>[Signature]</u> Date/Time: <u>7/27/07</u>		Phone Number: JEFFREY CAMPBELL		
Correct Preservations <u>Y/N/N/A</u>		Correct Containers <u>Y/N/N/A</u>		Cell Phone: 724-406-4426		
Receipt Temperature <u>54.4</u>		Receipt Temperature <u>54.4</u>		Email Address: jcampbell@moniteau.org		
Receipt Temperature <u>70.0</u>		Receipt Temperature <u>70.0</u>		Billing Address: 5100316		



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT

VIEW/EDIT RECORDS

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.93	070722	801		070722	D	1215	32382	22G0695-01	BROWNKA_225
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	801		070722	D	1215	32382	22G0695-01	BROWNKA_226
5100316	1013	FREE CHLORINE	301	0.66	071422	802		071422	D	1115	32382	22G1495-01	BROWNKA_812
5100316	1013	FREE CHLORINE	301	0.62	072122	803		072122	D	1100	32382	22G2281-01	BROWNKA_2097



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

29 July 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22G2887
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 400 Hall RR Sink	22G2887-01	Drinking Water	07/28/2022 10:15	7/28/22 13:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Kirsten Conoran

Kirsten Conoran
Project Manager



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

Moniteau School District
 1810 West Sunbury Road
 West Sunbury, PA 16061

Reported: 07/29/2022 11:55

Lab Sample ID#: 22G2887-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Vance Byram
Client Sample ID: 804 400 Hall RR Sink

Sample Date: 07/28/2022 10:15
Receipt Date: 07/28/2022 13:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11		Prep Method: No Prep - Field				
Chlorine, Free	<0.200	mg/L		0.200	VB	07/28/22 10:15	07/28/22 10:15

ENVIRONMENTAL SERVICE LABORATORIES INC

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209



22G2887

N 754

NORTHWEST DIVISION
950 Main Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209

SAMPLE REQUEST & CHAIN OF CUSTODY

3E 1 OF 1

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL#	Sample Type		# of Bottles	Container Type	Analysis Requested
		Date	Time			
Distribution: 804	22G2887	07/28/12	10:15	Field	Field	Free Chlorine 0.08 mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room 606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>						
<p>Notes/Special Instructions::</p> <p>Drinking Water Dassa McKinney - Weekly</p>						
<p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>		<p>Company/Name: MONITEAU SCHOOL DISTRICT</p> <p>Address: 391 HOOKER ROAD WEST SUNBURY, PA 16061 JEFFREY CAMPBELL</p> <p>Contact Person: JEFFREY CAMPBELL</p> <p>Phone Number: 724-406-4426</p> <p>Cell Phone: jcampbell@moniteau.org</p> <p>Email Address: jcampbell@moniteau.org</p> <p>Billing Address: 5100316</p> <p>PWSID: 5100316</p>				
<p>Received By: (Signature) <i>[Signature]</i></p> <p>Date/ Time 7/28/12 13:30</p>		<p>Received By: (Signature) _____ Date/ Time _____</p> <p>Relinquished By: (Signature) _____ Date/ Time _____</p> <p>Relinquished By: (Signature) _____ Date/ Time _____</p> <p>Relinquished By: (Signature) _____ Date/ Time _____</p>				
<p>Correct Preservations Y / N / NA</p>		<p>Correct Containers Y / N / NA</p> <p>Receipt Temperature _____</p>				



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.93	070722	801		070722	D	1215	32382	22G0695-01	BROWNKA_225
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	801		070722	D	1215	32382	22G0695-01	BROWNKA_226
5100316	1013	FREE CHLORINE	301	0.66	071422	802		071422	D	1115	32382	22G1495-01	BROWNKA_812
5100316	1013	FREE CHLORINE	301	0.62	072122	803		072122	D	1100	32382	22G2281-01	BROWNKA_2097
5100316	1013	FREE CHLORINE	301	0.08	072822	804		072822	D	1015	32382	22G2887-01	BROWNKA_2441



1803 Philadelphia Street
 Indiana, PA 15701
 P: (724) 463-8378
 F: (724) 465-4209
 PADEP: 32-00382

1276 Bentleyville Road
 Van Voorhis, PA 15366
 P: (724) 258-8378
 F: (724) 258-8376
 PADEP: 63-04247

435 Broad Street
 Montoursville, PA 17754
 P: (570) 321-9002
 F: (570) 321-1957
 PADEP: 41-04880

950 West Main Street
 Sharpsville, PA 16150
 P: (724) 463-8378 x 500
 F: (724) 465-4209
 PADEP: 43-04934

29 July 2022

Moniteau School District
 Attn: Jeffrey Campbell
 1810 West Sunbury Road
 West Sunbury, PA 16061

Work Order: 22G2889
Project: Drinking Water Moniteau Jr/Sr - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 400 Hall RR Sink	22G2889-01	Drinking Water	07/28/2022 09:50	7/28/22 14:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Kirsten Conoran

Kirsten Conoran
 Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

08 August 2022

Moniteau School District
Attn: Jeffrey Campbell
1810 West Sunbury Road
West Sunbury, PA 16061

Work Order: 22H0683
Project: Drinking Water Dassa McKinney - Weekly
Project Description: Drinking Water

Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 Room 408 Sink	22H0683-01	Drinking Water	07/28/2022 16:00	8/5/22 10:30	

Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

Definitions

RL Reporting Limit

Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

Approved By

Shane Molyneux
Project Manager



1803 Philadelphia Street
Indiana, PA 15701
P: (724) 463-8378
F: (724) 465-4209
PADEP: 32-00382

1276 Bentleyville Road
Van Voorhis, PA 15366
P: (724) 258-8378
F: (724) 258-8376
PADEP: 63-04247

435 Broad Street
Montoursville, PA 17754
P: (570) 321-9002
F: (570) 321-1957
PADEP: 41-04880

950 West Main Street
Sharpsville, PA 16150
P: (724) 463-8378 x 500
F: (724) 465-4209
PADEP: 43-04934

Moniteau School District
1810 West Sunbury Road
West Sunbury, PA 16061

Reported: 08/08/2022 11:32

Lab Sample ID#: 22H0683-01
Sample Type: Drinking Water
Sample Source: Grab
Sampler: Client
Client Sample ID: 804 Room 408 Sink

Sample Date: 07/28/2022 16:00
Receipt Date: 08/05/2022 10:30

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis							
Chlorine, Free	0.420	mg/L			Client	07/28/22 16:00	07/28/22 16:00

SAMPLE REQUEST & CHAIN OF CUSTODY

RE 1 OF 1

ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER
1803 Philadelphia St.
Indiana, PA 15701
(724) 463-TEST
FAX: (724) 465-4209

SOUTHERN DIVISION
1276 Benitesville Road
Van Voorhis, PA 15366
(724) 258-TEST
FAX: (724) 258-8376

NORTHERN DIVISION
435 Broad Street
Montoursville, PA 17754
(570) 321-9003
FAX: (570) 321-1957

NORTHWEST DIVISION
950 Mann Street
Sharpsville, PA 16
(724) 463-TEST
FAX: (724) 465-4209



FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL# 22H0683	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Grab	Time				
Distribution: 504	01	Date: 7/28/22	Time: 4:00 PM	DW	Field	Field	Free Chlorine 0.42 mg/L

- ROTATION**
- Wk 1 - 801 Kitchen Sink
 - Wk 2 - 802 Room 617 Sink
 - Wk 3 - 803 Room 606 Sink
 - Wk 4 - 804 Room 408 Sink
 - Wk 5 - 802 Room 617 Sink

Notes/Special Instructions:

Drinking Water Dassa McKinney - Weekly

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)

2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Sampled By: (Signature) Date/ Time: 8/22/22 1:55	Date/ Time: 8/22/22 1:55
Relinquished By: (Signature) Date/ Time: 8/22/22 1:55	Date/ Time: 8/22/22 1:55
Received By: (Signature) Date/ Time: 8/22/22 1:55	Date/ Time: 8/22/22 1:55
Relinquished By: (Signature) Date/ Time: 8/22/22 1:55	Date/ Time: 8/22/22 1:55
Relinquished By: (Signature) Date/ Time: 8/22/22 1:55	Date/ Time: 8/22/22 1:55
Correct Preservations Y / N / NA	Correct Containers Y / N / NA
Receipt Temperature 5.3	Receipt Temperature 5.3

Company Name: MONITEAU SCHOOL DISTRICT
 Address: 391 HOOKER ROAD
 WEST SUNBURY, PA 16061
 JEFFREY CAMPBELL
 Contact Person: JEFFREY CAMPBELL
 Phone Number: 724-406-4426
 Cell Phone: jcampbell@moniteau.org
 Email Address: jcampbell@moniteau.org
 Billing Address: 5100316
 PWSID: 5100316



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT
VIEW/EDIT RECORDS

5100316: DASSA MCKINNEY ELEM SCHOOL

SDWA1

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.93	070722	801		070722	D	1215	32382	22G0695-01	BROWNKA_225
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	070822	801		070722	D	1215	32382	22G0695-01	BROWNKA_226
5100316	1013	FREE CHLORINE	301	0.66	071422	802		071422	D	1115	32382	22G1495-01	BROWNKA_812
5100316	1013	FREE CHLORINE	301	0.62	072122	803		072122	D	1100	32382	22G2281-01	BROWNKA_2097
5100316	1013	FREE CHLORINE	301	0.08	072822	804		072822	D	1015	32382	22G2887-01	BROWNKA_2441
5100316	1013	FREE CHLORINE	301	0.42	072822	804		072822	D	1600	32382	22H0683-01	BROWNKA_2767