

**Moniteau School District**  
**Maintenance Department**  
**Dassa McKinney Elementary School**  
**Monthly Water Treatment**  
**Facility Report**



Dassa McKinney Elementary School Water Treatment Facility

Month	Day	PH	Iron	Cl2 Free	Cl2 Total	Hardness	Meter Reading	Operator	Time	Notes
Nov	2021									
1	Mon	8.7	0.03	0.75	0.80	2.40	12912400	Jeff R.	3:00P	4000
2	Tues	8.7	0.02	0.68	0.77	2.63	12917100	Jeff R.	3:00P	4700
3	Wed	8.7	0.04	0.58	0.64	2.15	12921600	Jeff R.	3:30P	4500
4	Thurs	8.7	0.02	0.65	0.74	2.27	12926200	Jeff R.	3:00P	4600
5	Fri	8.7	0.00	0.67	0.77	2.35	12930900	Jeff R.	3:00P	4760
6	Sat									
7	Sun									
8	Mon	8.7	0.02	0.71	0.79	2.89	12935400	Jeff R.	3:00P	4500
9	Tues	8.7	0.03	0.73	0.81	2.78	12939800	Jeff R.	3:30P	4400
10	Wed	8.7	0.02	0.74	0.83	2.23	12944200	Jeff R.	3:30P	4400
11	Thurs	8.7	0.01	0.75	0.85	2.88	12945000	Jeff R.	3:30P	800
12	Fri	8.7	0.00	0.72	0.81	2.16	12945800	Jeff R.	2:30P	800
13	Sat									
14	Sun									
15	Mon	8.7	0.02	0.64	0.73	2.89	12950200	Jeff R.	1:30P	4400
16	Tues	8.7	0.00	0.59	0.67	2.94	12954000	Jeff R.	2:00P	3800
17	Wed	8.7	0.03	0.55	0.65	3.25	12957200	Jeff R.	12:30P	3200
18	Thurs	8.7	0.02	0.54	0.63	2.88	12962400	Jeff R.	2:00P	5200
19	Fri	8.7	0.03	0.80	0.89	2.26	12965100	Jeff R.	12:00P	2700
20	Sat									
21	Sun									
22	Mon	8.7	0.00	0.71	0.79	2.48	12971700	Jeff R.	3:30P	6600
23	Tues	8.7	0.02	0.66	0.73	2.15	12975800	Jeff R.	3:30P	4100
24	Wed	8.7	0.01	0.73	0.81	2.79	12976300	Jeff R.	2:30P	500
25	Thurs									
26	Fri									
27	Sat									
28	Sun									
29	Mon									
30	Tues	8.7	0.04	0.43	0.49	3.95	12980500	Jeff R.	3:00P	4200
31										

Meter Reading on 10/29/21 - 12908400







1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

23 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

**Work Order: 1112036**  
**Project: Drinking Water Dassa McKinney - Weekly**  
**Project Description: Drinking Water**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 Room 408 Sink	1112036-01	Drinking Water	11/22/2021 08:50	11/22/21 14:05	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions

RL Reporting Limit

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

#### Approved By

Rebecca Erwin  
Client Services Manager



1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/23/2021 09:15

**Lab Sample ID#:** 1112036-01  
**Sample Type:** Drinking Water  
**Sample Source:** Grab  
**Sampler:** Paul Somogyi  
**Client Sample ID:** 804 Room 408 Sink

**Sample Date:** 11/22/2021 08:50  
**Receipt Date:** 11/22/2021 14:05

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>Field Analysis</b>		<b>Analytical Method: SM4500-Cl G-11</b>			<b>Prep Method: No Prep - Field</b>		
Chlorine, Free	0.410	mg/L		0.200	PS	11/22/21 08:50	11/22/21 08:50

# ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER  
1803 Philadelphia St.  
Indiana, PA 15701  
(724) 463-TEST  
FAX: (724) 465-4209

SOUTHERN DIVISION  
1276 Bentleyville Road  
Van Voorhis, PA 15366  
(724) 258-TEST  
FAX: (724) 258-8376



1112036

NORTHWEST DIVISION  
950 Main Street  
Sharpsville, PA 16  
(724) 463-TEST  
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY

## SAMPLE REQUEST & CHAIN OF CUSTODY

RE 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type Preservative	Analysis Requested
		Date	Time				
Distribution: <u>804</u>	<u>1112036</u>	<u>11-27-21</u>	<u>0850</u>	DW	Field	Field	Free Chlorine <u>4.1</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room-606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>							
<p>Notes/Special Instructions:</p> <p><i>Drinking Water Dassa McKinney - Weekly</i></p>							
<p>Company/Name: <b>MONITEAU SCHOOL DISTRICT</b></p> <p>Address: <b>391 HOOKER ROAD WEST SUNBURY, PA 16061</b></p> <p>Contact Person: <b>JEFFREY CAMPBELL</b></p> <p>Phone Number: <b>724-406-4426</b></p> <p>Cell Phone: <b>jcampbell@moniteau.org</b></p> <p>Email Address: <b>jcampbell@moniteau.org</b></p> <p>Billing Address: <b>5100316</b></p> <p>PWSID: <b>5100316</b></p>							
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p> <p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>							
<p>Sampled By: (Signature) <i>[Signature]</i></p> <p>Date/ Time <u>11-27-21 0850</u></p>		<p>Received By: (Signature) <i>[Signature]</i></p> <p>Date/ Time <u>11-29-21 1405</u></p>		<p>Relinquished By: (Signature) <i>[Signature]</i></p> <p>Date/ Time <u>11-27-21 1405</u></p>		<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>	
<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>		<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>		<p>Relinquished By: (Signature)</p> <p>Date/ Time</p>		<p>Correct Preservations Y / N / NA</p> <p>Correct Containers Y / N / NA</p> <p>Receipt Temperature</p>	

**Department of Environmental Protection**


E-Government Application for Drinking Water  
Program

SAFE DRINKING WATER ACT  
VIEW/EDIT RECORDS

**5100316: DASSA MCKINNEY ELEM SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.82	110421	801		110421	D	1150	32382	1110565-01	BROWNKA_95
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	801		110421	D	1150	32382	1110565-01	BROWNKA_96
5100316	1013	FREE CHLORINE	301	0.57	111121	802		111121	D	1115	32382	1111149-01	BROWNKA_306
5100316	1013	FREE CHLORINE	301	0.44	111821	803		111821	D	1152	32382	1111847-01	BROWNKA_1001
5100316	1013	FREE CHLORINE	301	0.41	112221	804		112221	D	0850	32382	1112036-01	BROWNKA_1120

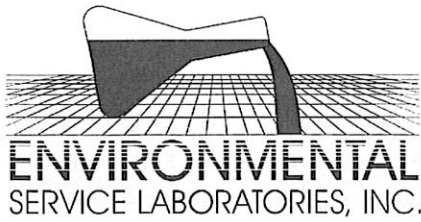

1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

19 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

**Work Order: 1111847**  
**Project: Drinking Water Dassa McKinney - Weekly**  
**Project Description: Drinking Water**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
803 Room 606 Sink	1111847-01	Drinking Water	11/18/2021 11:52	11/18/21 17:00	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions

RL Reporting Limit

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

#### Approved By

Carrie Sutton-White  
Project Manager



1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/19/2021 16:11

**Lab Sample ID#:** 1111847-01  
**Sample Type:** Drinking Water  
**Sample Source:** Grab  
**Sampler:** Paul Somogyi  
**Client Sample ID:** 803 Room 606 Sink

**Sample Date:** 11/18/2021 11:52  
**Receipt Date:** 11/18/2021 17:00

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>Field Analysis</b>	<b>Analytical Method: SM4500-Cl G-11</b>			<b>Prep Method: No Prep - Field</b>			
Chlorine, Free	0.440	mg/L		0.200	PS	11/18/21 11:52	11/18/21 11:52

**SAMPLE REQUEST & CHAIN OF CUSTODY**

SE 1 OF 1

**ENVIRONMENTAL SERVICE LABORATORIES, INC.**

HEADQUARTER  
1803 Philadelphia St.  
Indiana, PA 15701  
(724) 463-TEST  
FAX: (724) 465-4209

SOUTHERN DIVISION  
1276 Bentleyville Road  
Van Voorhis, PA 15366  
(724) 258-TEST  
FAX: (724) 258-8376

NORTHWEST DIVISION  
950 Main Street  
Sharpsville, PA 16  
(724) 463-TEST  
FAX: (724) 465-4209

1111847

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Date	Time				
Distribution: <u>803</u>	<u>111847</u>	<u>11-18-21</u>	<u>11:52</u>	DW	Field	Field	Free Chlorine <u>.44</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803 Room 606 Sink</p> <p>Wk 4 - 804-Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>							
<p>Notes/Special Instructions:</p> <p><i>Drinking Water Dassa McKinney - Weekly</i></p>							
<p>Company/Name: <b>MONITEAU SCHOOL DISTRICT</b></p> <p>Address: <b>391 HOOKER ROAD</b></p> <p><b>WEST SUNBURY, PA 16061</b></p> <p>Contact Person: <b>JEFFREY CAMPBELL</b></p> <p>Phone Number: <b>724-406-4426</b></p> <p>Cell Phone: <b>jcampbell@moniteau.org</b></p> <p>Billing Address: <b>5100316</b></p> <p>PWSID: <b>5100316</b></p>							
<p>Received By: (Signature) <u>[Signature]</u> Date/ Time <u>11/18/21 17:08</u></p> <p>Received By: (Signature) _____ Date/ Time _____</p> <p>Received By: (Signature) _____ Date/ Time _____</p> <p>Received By: (Signature) _____ Date/ Time _____</p> <p>Correct Preservations Y / N / NA _____ Correct Containers Y / N / NA _____ Receipt Temperature _____</p>							

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)

2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

Department of Environmental Protection

E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT

VIEW/EDIT RECORDS

**5100316: DASSA MCKINNEY ELEM SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.82	110421	801		110421	D	1150	32382	1110565-01	BROWNKA_95
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	801		110421	D	1150	32382	1110565-01	BROWNKA_96
5100316	1013	FREE CHLORINE	301	0.57	111121	802		111121	D	1115	32382	1111149-01	BROWNKA_306
5100316	1013	FREE CHLORINE	301	0.44	111821	803		111821	D	1152	32382	1111847-01	BROWNKA_1001





1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

11 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

Work Order: 1111149  
Project: Drinking Water Dassa McKinney - Weekly  
Project Description: Drinking Water

## Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
802 Room 617 Sink	1111149-01	Drinking Water	11/11/2021 11:15	11/11/21 14:00	

### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

### Definitions

RL Reporting Limit

### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

### Approved By

Rebecca Erwin  
Client Services Manager





1803 Philadelphia Street  
 Indiana, PA 15701  
 P: (724) 463-8378  
 F: (724) 465-4209  
 PADEP: 32-00382

1276 Bentleyville Road  
 Van Voorhis, PA 15366  
 P: (724) 258-8378  
 F: (724) 258-8378  
 PADEP: 63-04247

435 Broad Street  
 Montoursville, PA 17754  
 P: (570) 321-9002  
 F: (570) 321-1957  
 PADEP: 41-04880

950 West Main Street  
 Sharpsville, PA 16150  
 P: (724) 463-8378 x 500  
 F: (724) 465-4209  
 PADEP: 43-04934

Moniteau School District  
 1810 West Sunbury Road  
 West Sunbury, PA 16061

Reported: 11/11/2021 18:20

Lab Sample ID#: 1111149-01  
 Sample Type: Drinking Water  
 Sample Source: Grab  
 Sampler: Paul Somogyi  
 Client Sample ID: 802 Room 617 Sink

Sample Date: 11/11/2021 11:15  
 Receipt Date: 11/11/2021 14:00

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
Field Analysis	Analytical Method: SM4500-Cl G-11				Prep Method: No Prep - Field		
Chlorine, Free	0.570	mg/L		0.200	PS	11/11/21 11:15	11/11/21 11:15





E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT  
VIEW/EDIT RECORDS

**5100316: DASSA MCKINNEY ELEM SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.82	110421	801		110421	D	1150	32382	1110565-01	BROWNKA_95
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	801		110421	D	1150	32382	1110565-01	BROWNKA_96
5100316	1013	FREE CHLORINE	301	0.57	111121	802		111121	D	1115	32382	1111149-01	BROWNKA_306



**ENVIRONMENTAL SERVICE  
LABORATORIES, INC.**

HEADQUARTER  
1803 Philadelphia St  
Indiana, PA 15701  
(724) 463-TEST  
FAX: (724) 465-4209



1111149

VISION  
91  
VA 17754

NORTHWEST DIVISION  
950 Main Street  
Shersville, PA 16  
(724) 463-TEST  
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY  
-1957


**SAMPLE REQUEST & CHAIN OF CUSTODY**

3E 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Grab	Time				
Distribution: <u>802</u>	<u>1111149</u>	Date: <u>11-16-21</u>	Time: <u>11:15</u>	DW	Field	Field	Free Chlorine <u>.57</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 801 Kitchen Sink</p> <p>Wk 2 - 802 Room 617 Sink</p> <p>Wk 3 - 803-Room 606 Sink</p> <p>Wk 4 - 804 Room 408 Sink</p> <p>Wk 5 - 802 Room 617 Sink</p>							
Notes/Special Instructions:							
Drinking Water Dassa McKinney - Weekly							
1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1.12% PER MONTH (13% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.) 2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.				Company Name: MONITEAU SCHOOL DISTRICT Address: 391 HOOKER ROAD WEST SUNBURY, PA 16061 JEFFREY CAMPBELL Contact Person: 724-406-4426 Phone Number: icampbell@moniteau.org Cell Phone: 5100316 Email Address: Billing Address: PWSID:			
Sampled By: (Signature) <u>[Signature]</u> Date/Time <u>11-16-21 11:15</u> Relinquished By: (Signature) <u>[Signature]</u> Date/Time <u>11-16-21 13:17</u> Relinquished By: (Signature) _____ Date/Time _____ Relinquished By: (Signature) _____ Date/Time _____	Received By: (Signature) <u>[Signature]</u> Date/Time _____ Received By: (Signature) _____ Date/Time _____ Received By: (Signature) _____ Date/Time _____	Correct Preservations Y/N/A Correct Containers Y/N/A Receipt Temperature _____					





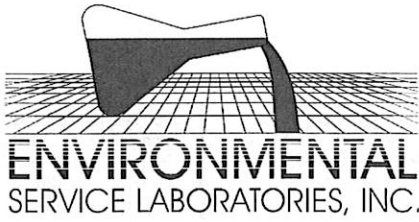

1803 Philadelphia Street  
 Indiana, PA 15701  
 P: (724) 463-8378  
 F: (724) 465-4209  
 PADEP: 32-00382

1276 Bentleyville Road  
 Van Voorhis, PA 15366  
 P: (724) 258-8378  
 F: (724) 258-8376  
 PADEP: 63-04247

435 Broad Street  
 Montoursville, PA 17754  
 P: (570) 321-9002  
 F: (570) 321-1957  
 PADEP: 41-04880

950 West Main Street  
 Sharpsville, PA 16150  
 P: (724) 463-8378 x 500  
 F: (724) 465-4209  
 PADEP: 43-04934

11 November 2021

Moniteau School District  
 Attn: Jeffrey Campbell  
 1810 West Sunbury Road  
 West Sunbury, PA 16061

**Work Order: 1110565**  
**Project: Drinking Water Dassa McKinney - Monthly 801**  
**Project Description: Drinking Water**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
801 Kitchen Sink	1110565-01	Drinking Water	11/04/2021 11:50	11/4/21 15:05	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions

RL Reporting Limit

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.  
 Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

#### Approved By

Rebecca Erwin  
 Client Services Manager





1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/11/2021 10:03

**Lab Sample ID#:** 1110565-01  
**Sample Type:** Drinking Water  
**Sample Source:** Grab  
**Sampler:** Paul Somogyi  
**Client Sample ID:** 801 Kitchen Sink

**Sample Date:** 11/04/2021 11:50  
**Receipt Date:** 11/04/2021 15:05

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>Field Analysis</b>		<b>Analytical Method: SM4500-CI G-11</b>			<b>Prep Method: No Prep - Field</b>		
Chlorine, Free	0.820	mg/L		0.200	PS	11/04/21 11:50	11/04/21 11:50
<b>Microbiology</b>		<b>Analytical Method: SM9223 B-04</b>			<b>Prep Method: No Prep - Micro</b>		
Total Coliform	Absent	per 100 mL		1	KD	11/04/21 15:28	11/05/21 15:31
E. Coli	Absent	per 100 mL		1	KD	11/04/21 15:28	11/05/21 15:31

This sample MEETS current EPA and DEP bacteriological standards of no detectable coliform bacteria per 100 mL sample.

3E \_\_\_1\_\_\_ OF \_\_\_1\_\_\_

**SAMPLE REQUEST & CHAIN OF CUSTODY**

**ENVIRONMENTAL SERVICE LABORATORIES, INC.**

**HEADQUARTER**  
 1803 Philadelphia St.  
 Indiana, PA 15701  
 (724) 463-TEST  
 FAX: (724) 465-4209

**SOUTHERN DIVISION**  
 1276 Bentleyville Road  
 Van Voorhis, PA 15366  
 (724) 258-TEST  
 FAX: (724) 258-8376



**NORTHWEST DIVISION**  
 950 Main Street  
 Sharpsville, PA 16  
 (724) 463-TEST  
 FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY

Sample Identification <b>801 KITCHEN SINK</b> <b>802 ROOM-617 SINK</b>	ESL# 110565	Matrix DW	# of Bottles 1	Container Type Preservative STERILE PLASTIC NA THIO	Analysis Requested TC / EC Free Chlorine .82 mg/L
	Sample Type Grab Date 11-4-21 Time 11:50				

**Rotation:**  
 801: Jan, Mar, May, Jul, Sep,  
 Nov  
 802: Feb, Apr, Jun, Aug, Oct,  
 Dec

THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.

1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1-12% PER MONTH (16% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW)
2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.

**Drinking Water Dassa McKinney - Monthly**

Notes/Special Instructions:

Company/Name: <b>MONITEAU SCHOOL DISTRICT</b>	Address: <b>391 HOOKER ROAD WEST SUNBURY, PA 16061 JEFFREY CAMPBELL</b>	Contact Person: <b>JEFFREY CAMPBELL</b>	Phone Number: <b>724-406-4426</b>	Cell Phone: <b>jcampbell@moniteau.org</b>	Email Address: <b>jcampbell@moniteau.org</b>	Billing Address: <b>5100316</b>	PWSID: <b>5100316</b>
Sampled By: (Signature) <i>[Signature]</i>	Date/ Time 11-4-21 11:50	Relinquished By: (Signature) <i>[Signature]</i>	Date/ Time 11-4-21 14:48	Received By: (Signature) <i>[Signature]</i>	Date/ Time 11/4/21 15:05	Received By: (Signature)	Date/ Time
Relinquished By: (Signature)	Date/ Time	Relinquished By: (Signature)	Date/ Time	Relinquished By: (Signature)	Date/ Time	Relinquished By: (Signature)	Date/ Time
Correct Preservations Y / N / NA	Correct Containers Y / N / NA	Receipt Temperature	<b>7.6°C</b>				



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT  
VIEW/EDIT RECORDS

**5100316: DASSA MCKINNEY ELEM SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100316	1013	FREE CHLORINE	301	0.82	110421	801		110421	D	1150	32382	1110565-01	BROWNKA_95
5100316	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	801		110421	D	1150	32382	1110565-01	BROWNKA_96

**Moniteau School District  
Maintenance Department  
Moniteau High School  
Monthly Water Treatment  
Facility Report**











1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

23 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

**Work Order: 1112033**  
**Project: Drinking Water Moniteau Jr/Sr - Weekly**  
**Project Description: Drinking Water**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
804 400 Hall RR Sink	1112033-01	Drinking Water	11/22/2021 09:10	11/22/21 14:05	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions


RL Reporting Limit

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

#### Approved By

Rebecca Erwin  
Client Services Manager

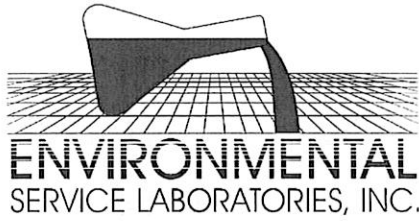

1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/23/2021 09:15

**Lab Sample ID#:** 1112033-01  
**Sample Type:** Drinking Water  
**Sample Source:** Grab  
**Sampler:** Paul Somogyi  
**Client Sample ID:** 804 400 Hall RR Sink

**Sample Date:** 11/22/2021 09:10  
**Receipt Date:** 11/22/2021 14:05

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>Field Analysis</b>							
<b>Analytical Method: SM4500-Cl G-11</b>				<b>Prep Method: No Prep - Field</b>			
Chlorine, Free	0.500	mg/L		0.200	PS	11/22/21 09:10	11/22/21 09:10



**Department of Environmental Protection**

E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT

VIEW/EDIT RECORDS

**5100324: MONITEAU JR/SR HIGH SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.71	110421	704		110421	D	1210	32382	1110566-01	BROWNKA_97
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	704		110421	D	1210	32382	1110566-01	BROWNKA_98
5100324	1013	FREE CHLORINE	301	0.96	111121	802		111121	D	1140	32382	1111151-01	BROWNKA_307
5100324	1013	FREE CHLORINE	301	0.52	111821	803		111821	D	1215	32382	1111848-01	BROWNKA_1002
5100324	1013	FREE CHLORINE	301	0.5	112221	804		112221	D	0910	32382	1112033-01	BROWNKA_1121



1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

19 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

**Work Order: 1111848**  
**Project: Drinking Water Moniteau Jr/Sr - Weekly**  
**Project Description: Drinking Water**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
803 Admin Sink	1111848-01	Drinking Water	11/18/2021 12:15	11/18/21 17:00	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions

RL Reporting Limit

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

#### Approved By

Carrie Sutton-White  
Project Manager



1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/19/2021 16:11

**Lab Sample ID#:** 1111848-01  
**Sample Type:** Drinking Water  
**Sample Source:** Grab  
**Sampler:** Paul Somogyi  
**Client Sample ID:** 803 Admin Sink

**Sample Date:** 11/18/2021 12:15  
**Receipt Date:** 11/18/2021 17:00

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>Field Analysis</b>		<b>Analytical Method: SM4500-Cl G-11</b>			<b>Prep Method: No Prep - Field</b>		
Chlorine, Free	0.520	mg/L		0.200	PS	11/18/21 12:15	11/18/21 12:15

**SAMPLE REQUEST & CHAIN OF CUSTODY**

**ENVIRONMENTAL SERVICE LABORATORIES, INC.**

HEADQUARTER  
1803 Philadelphia St.  
Indiana, PA 15701  
(724) 463-TEST  
FAX: (724) 465-4209

SOUTHERN DIVISION  
1276 Bentleyville Road  
Van Voorhis, PA 15366  
(724) 258-TEST  
FAX: (724) 258-8376



NORTHWEST DIVISION  
950 Main Street  
Sharpville, PA 16  
(724) 463-TEST  
FAX: (724) 465-4209

FOR INTERNAL LABORATORY USE ONLY

Sample Identification	ESL# 111848	Sample Type Grab	Matrix	# of Bottles	Container Type Preservative	Analysis Requested
Distribution: 803	01	Date: 11/21/15 Time: 1215	DW	Field	Field	Free Chlorine, 52 mg/L
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802-Room-204 Sink</p> <p>Wk 3 - 803 Admin-Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>						
<p>Notes/Special Instructions:</p> <p>Drinking Water Moniteau Jr/Sr - Weekly</p>						
<p>Company/Name: MONITEAU SCHOOL DISTRICT</p> <p>Address: 391 HOOKER ROAD</p> <p>Contact Person: WEST SUNBURY, PA 16061</p> <p>Phone Number: JEFFREY CAMPBELL</p> <p>Cell Phone: 724-406-4426</p> <p>Email Address: jcampbell@moniteau.org</p> <p>Billing Address:</p> <p>PWSID: 5100324</p>						
<p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>						
Sampled By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time	Correct Containers	Y / N / NA	Receipt Temperature
	11/21/15 1215		11/21/15 1215			
Relinquished By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time	Correct Containers	Y / N / NA	Receipt Temperature
	11/21/15 1405					
Relinquished By: (Signature)	Date/ Time	Received By: (Signature)	Date/ Time	Correct Containers	Y / N / NA	Receipt Temperature

Department of Environmental Protection

E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT

VIEW/EDIT RECORDS

**5100324: MONITEAU JR/SR HIGH SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.71	110421	704		110421	D	1210	32382	1110566-01	BROWNKA_97
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	704		110421	D	1210	32382	1110566-01	BROWNKA_98
5100324	1013	FREE CHLORINE	301	0.96	111121	802		111121	D	1140	32382	1111151-01	BROWNKA_307
5100324	1013	FREE CHLORINE	301	0.52	111821	803		111821	D	1215	32382	1111848-01	BROWNKA_1002





1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

11 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

**Work Order: 111151**  
**Project: Drinking Water Moniteau Jr/Sr - Weekly**  
**Project Description: Drinking Water**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
802 Room 204 Sink	111151-01	Drinking Water	11/11/2021 11:40	11/11/21 14:00	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions

RL Reporting Limit

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.

#### Approved By

Rebecca Erwin  
Client Services Manager



1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/11/2021 17:55

**Lab Sample ID#:** 1111151-01  
**Sample Type:** Drinking Water  
**Sample Source:** Grab  
**Sampler:** Paul Somogyi  
**Client Sample ID:** 802 Room 204 Sink

**Sample Date:** 11/11/2021 11:40  
**Receipt Date:** 11/11/2021 14:00

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>Field Analysis</b>	<b>Analytical Method: SM4500-Cl G-11</b>			<b>Prep Method: No Prep - Field</b>			
Chlorine, Free	0.960	mg/L		0.200	PS	11/11/21 11:40	11/11/21 11:40

**5100324: MONITEAU JR/SR HIGH SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.71	110421	704		110421	D	1210	32382	1110566-01	BROWNKA_97
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	704		110421	D	1210	32382	1110566-01	BROWNKA_98
5100324	1013	FREE CHLORINE	301	0.96	111121	802		111121	D	1140	32382	1111151-01	BROWNKA_307

# ENVIRONMENTAL SERVICE LABORATORIES, INC.

HEADQUARTER  
1803 Philadelphia St.  
Indiana, PA 15701  
(724) 463-TEST  
FAX: (724) 465-4209

SOUTHERN DIVI:  
1276 Bentleyville  
Van Voorhis, PA 1  
(724) 258-TEST  
FAX: (724) 258-8376

1111151

NORTHWEST DIVISION  
950 Main Street  
Sharpsville, PA 16  
(724) 463-TEST  
FAX: (724) 465-4209

## SAMPLE REQUEST & CHAIN OF CUSTODY

3E 1 OF 1

Sample Identification	ESL#	Sample Type		Matrix	# of Bottles	Container Type	Analysis Requested
		Date	Time				
Distribution: <u>S&amp;S</u>	111151	11/21	1140	DW	Field	Field	Free Chlorine <u>.96</u> mg/L
<p>ROTATION</p> <p>Wk 1 - 704 Kitchen Sink</p> <p>Wk 2 - 802 Room 204 Sink</p> <p>Wk 3 - 803 Admin Sink</p> <p>Wk 4 - 804 400 Hall RR Sink</p> <p>Wk 5 - 804 400 Hall RR Sink</p>							
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p> <p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW).</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>							
<p>Sampled By: (Signature) <u>[Signature]</u> Date/ Time <u>11/21 1140</u></p> <p>Relinquished By: (Signature) <u>[Signature]</u> Date/ Time <u>11/21 1347</u></p> <p>Relinquished By: (Signature) _____ Date/ Time _____</p> <p>Relinquished By: (Signature) _____ Date/ Time _____</p>				<p>Received By: (Signature) <u>[Signature]</u> Date/ Time <u>11/21 1400</u></p> <p>Received By: (Signature) _____ Date/ Time _____</p> <p>Received By: (Signature) _____ Date/ Time _____</p>			
<p>Correct Preservations Y / N / NA</p>				<p>Correct Containers Y / N / NA</p>			
<p>Notes/Special Instructions:</p> <p><i>Drinking Water Moniteau Jr/Sr - Weekly</i></p>				<p>Company/Name: <b>MONITEAU SCHOOL DISTRICT</b></p> <p>Address: <b>391 HOOKER ROAD</b> <b>WEST SUNBURY, PA 16061</b></p> <p>Contact Person: <b>JEFFREY CAMPBELL</b></p> <p>Phone Number: <b>724-406-4426</b></p> <p>Cell Phone: <b>jcampbell@moniteau.org</b></p> <p>Billing Address: <b>724-406-4426</b></p> <p>PWSID: <b>5100324</b></p>			



1803 Philadelphia Street  
 Indiana, PA 15701  
 P: (724) 463-8378  
 F: (724) 465-4209  
 PADEP: 32-00382

1276 Bentleyville Road  
 Van Voorhis, PA 15366  
 P: (724) 258-8378  
 F: (724) 258-8376  
 PADEP: 63-04247

435 Broad Street  
 Montoursville, PA 17754  
 P: (570) 321-9002  
 F: (570) 321-1957  
 PADEP: 41-04880

950 West Main Street  
 Sharpville, PA 16150  
 P: (724) 463-8378 x 500  
 F: (724) 465-4209  
 PADEP: 43-04934

11 November 2021

Moniteau School District  
 Attn: Jeffrey Campbell  
 1810 West Sunbury Road  
 West Sunbury, PA 16061

**Work Order: 1110566**  
**Project: Drinking Water Moniteau Jr/Sr - Monthly 704**  
**Project Description: Drinking Water**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
704 Kitchen Main Sink	1110566-01	Drinking Water	11/04/2021 12:10	11/4/21 15:05	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions

RL Reporting Limit

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.  
 Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

#### Approved By

Rebecca Erwin  
 Client Services Manager





1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/11/2021 10:03

**Lab Sample ID#:** 1110566-01  
**Sample Type:** Drinking Water  
**Sample Source:** Grab  
**Sampler:** Paul Somogyi  
**Client Sample ID:** 704 Kitchen Main Sink

**Sample Date:** 11/04/2021 12:10  
**Receipt Date:** 11/04/2021 15:05

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>Field Analysis</b>		<b>Analytical Method: SM4500-Cl G-11</b>			<b>Prep Method: No Prep - Field</b>		
Chlorine, Free	0.710	mg/L		0.200	PS	11/04/21 12:10	11/04/21 12:10
<b>Microbiology</b>		<b>Analytical Method: SM9223 B-04</b>			<b>Prep Method: No Prep - Micro</b>		
Total Coliform	Absent	per 100 mL		1	KD	11/04/21 15:28	11/05/21 15:31
E. Coli	Absent	per 100 mL		1	KD	11/04/21 15:28	11/05/21 15:31

This sample MEETS current EPA and DEP bacteriological standards of no detectable coliform bacteria per 100 mL sample.

# ENVIRONMENTAL SERVICE LABORATORIES, INC

HEADQUARTER  
1803 Philadelphia St.  
Indiana, PA 15701  
(724) 463-TEST  
FAX: (724) 465-4209

SOUTHERN DIVISION  
1276 Bentleyville Road  
Van Voorhis, PA 15366  
(724) 258-TEST  
FAX: (724) 258-8376




NORTHWEST DIVISION  
950 Main Street  
Sharpshville, PA 16150  
(724) 463-TEST  
FAX: (724) 465-4209

## SAMPLE REQUEST & CHAIN OF CUSTODY

3E 1 OF 1

FOR INTERNAL LABORATORY USE ONLY

Sample Identification <b>CIRCLE ONE:</b> 704-KITCHEN MAIN SINK 802 ROOM 204 SINK	ESL# 110566	Sample Type Grab	Matrix DW	# of Bottles 1	Container Type Preservative STERILE PLASTIC NA THIO	Analysis Requested TC / EC Free Chlorine <u>71</u>
	Date 1/4/21	Time 12:10				
<p>704: Jan, Mar, May, Jul, Sept, Nov</p> <p>802: Feb, Apr, Jun, Aug, Oct, Dec</p>						
<p>THE UNDERSIGNED PURCHASER HEREBY AGREES TO PAY SERVICE CHARGES ON ACCOUNTS OVER 31 DAYS OLD.</p>						
<p>1. THESE SERVICE CHARGES WILL ACCRUE AT THE RATE OF 1 1/2% PER MONTH (18% PER ANNUM OR THE MAXIMUM ALLOWED BY LAW.)</p> <p>2. THE UNDERSIGNED PURCHASER AGREES TO PAY, IN THE EVENT HIS ACCOUNT BECOMES DELINQUENT AND IS TURNED OVER TO ANY ATTORNEY FOR COLLECTION, REASONABLE ATTORNEY'S FEES PLUS ALL COURT AND ATTENDANT COLLECTION COSTS.</p>						
<p>Sampled By: (Signature) <i>[Signature]</i> Date/ Time 11-4-21 12:10</p>		<p>Received By: (Signature) <i>Mayla Dawson</i> Date/ Time 11/4/21 1505</p>				
<p>Relinquished By: (Signature) <i>[Signature]</i> Date/ Time 11-4-21 1408</p>		<p>Received By: (Signature) _____ Date/ Time _____</p>				
<p>Relinquished By: (Signature) _____ Date/ Time _____</p>		<p>Received By: (Signature) _____ Date/ Time _____</p>				
<p>Relinquished By: (Signature) _____ Date/ Time _____</p>		<p>Received By: (Signature) _____ Date/ Time _____</p>				
<p>Correct Preservations Y / N / NA</p>		<p>Correct Containers Y / N / NA</p>		<p>Receipt Temperature <u>6.35</u> °C</p>		
<p>Notes/Special Instructions: <b>Drinking Water Moniteau Jr/Sr - Monthly</b></p>						
<p>Company Name: <b>MONITEAU SCHOOL DISTRICT</b></p> <p>Address: <b>1810 WEST SUNBURY ROAD WEST SUNBURY, PA 16061</b></p> <p>Contact Person: <b>JEFFREY CAMPBELL</b></p> <p>Phone Number: <b>724-406-4426</b></p> <p>Cell Phone: <b>jcampbell@moniteau.org</b></p> <p>Billing Address: _____</p> <p>PWSID: <b>5100324</b></p>						



E-Government Application for Drinking Water Program

SAFE DRINKING WATER ACT  
VIEW/EDIT RECORDS

**5100324: MONITEAU JR/SR HIGH SCHOOL**

**SDWA1**

PWSID	Contam ID	Contam	Analysis Method	Result	Analysis Date	Location ID 1	Location ID 2	Sample Date	Sample Type	Sample Time	Lab ID	Sample ID	Record ID
5100324	1013	FREE CHLORINE	301	0.71	110421	704		110421	D	1210	32382	1110566-01	BROWNKA_97
5100324	3100	TOTAL COLIFORM PRESENCE	331	0.0	110521	704		110421	D	1210	32382	1110566-01	BROWNKA_98



**Moniteau School District  
Maintenance Department  
Moniteau High School  
Monthly Waste Water Treatment  
Facility Report**





COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF CLEAN WATER

DISCHARGE MONITORING REPORT (DMR)

NAME: MONITEAU SCH DIST  
 ADDRESS: 1810 W SUNBURY RD, WEST SUNBURY, PA, 16061-1220  
 FACILITY: MONITEAU JR SR HIGH SCHOOL  
 LOCATION: 1810 W SUNBURY RD, WEST SUNBURY, PA, 16061-1220  
 STAGE: Final Effluent

PA0091341
PERMIT NUMBER

001
OUTFALL NUMBER

Reporting Frequency: Monthly  
 DMR Effective From: 11/01/2021  
 DMR Effective To: 11/30/2021  
 Permit Expires: 05/31/2022  
 Permit Application Due: 12/02/2021  
 No Discharge:

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
2021	11	01	2021	11	30

FROM

PARAMETER	SAMPLE MEASUREMENT	QUANTITY OR LOADING			QUANTITY OR CONCENTRATION			SAMPLING FREQUENCY	SAMPLING TYPE
		VALUE	UNITS	VALUE	VALUE	UNITS	VALUE		
Dissolved Oxygen (00300)	SAMPLE MEASUREMENT	***		6.69	***	***		1/week	Grab
	PERMIT REQUIREMENT	***		4.0 Min	***	***		1/week	Grab
pH (00400)	SAMPLE MEASUREMENT	***		6.23	***	7.80		1/week	Grab
	PERMIT REQUIREMENT	***		6.0 Min	***	9.0 Max		1/week	Grab
Total Suspended Solids (00530)	SAMPLE MEASUREMENT	***		***	***	5.0		2/month	Grab
	PERMIT REQUIREMENT	***		***	***	30 Avg Mo		2/month	Grab
Total Nitrogen (00600)	SAMPLE MEASUREMENT	***		***	***	15.55		2/month	Grab
	PERMIT REQUIREMENT	***		***	***	Monitor & Report Avg Mo		2/month	Grab
Total Phosphorus (00665)	SAMPLE MEASUREMENT	***		***	***	1.46		2/month	Grab
	PERMIT REQUIREMENT	***		***	***	Monitor & Report Avg Mo		2/month	Grab
Ultraviolet light intensity (49607)	SAMPLE MEASUREMENT	***		***	***	5.45		1/week	Grab
	PERMIT REQUIREMENT	***		***	***	Monitor & Report Avg Mo		1/week	Grab
Flow (50050)	SAMPLE MEASUREMENT	.002589		***	***	***		1/week	Measured
	PERMIT REQUIREMENT	Monitor & Report Avg Mo	MGD	***	***	***		1/week	Measured



COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
BUREAU OF CLEAN WATER

DISCHARGE MONITORING REPORT (DMR)

PARAMETER	SAMPLE MEASUREMENT	QUANTITY OR LOADING			QUANTITY OR CONCENTRATION				SAMPLING FREQUENCY	SAMPLING TYPE
		VALUE	VALUE	UNITS	VALUE	VALUE	VALUE	UNITS		
Fecal Coliform (74055)	SAMPLE MEASUREMENT	***	***	***	<1.0	<1.0	10000	No./100 ml	2/month	Grab
	PERMIT REQUIREMENT	***	***	***	Geo Mean	IMAX	***		2/month	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5) (80082)	SAMPLE MEASUREMENT	***	***	***	<2.00	25	***	mg/L	2/month	Grab
	PERMIT REQUIREMENT	***	***	***	Avg Mo	***	***		2/month	Grab
Facility Comments										

COMMENT DETAILS

COMMENTS	OPERATOR NAME	OPERATOR CERTIFICATION NUMBER	OPERATOR CONTACT NUMBER
----------	---------------	-------------------------------	-------------------------





JEFFREY CAMPBELL <jcampbell@moniteau.org>

---

## Your eDMR Report Has Been Received For Permit No. PA0091341

1 message

---

depgreenporthelpdesk@state.pa.us <depgreenporthelpdesk@state.pa.us>  
To: jcampbell@moniteau.org, mcafoose92@hotmail.com

Thu, Dec 2, 2021 at 9:21 AM

This email is to confirm that the following report was received by DEP through the eDMR system:

**Facility Name:** MONITEAU JR SR HIGH SCHOOL  
**Permit Number:** PA0091341  
**Report Frequency:** Monthly  
**Report Type:** DMR  
**Reporting Period:** 11/01/2021-11/30/2021  
**Report Due Date:** 12/28/2021

**Submitted By:** Jeffrey Campbell  
**Submission Id:** 298548  
**Submission Status:** Received  
**Submission Type:** Original

To view the details of this report, access the eDMR system through DEP's [GreenPort](#) and select the link for View/Revise Submitted.





Moniteau School District  
Maintenance Department  
High School Sewage Plant

Monthly Operations Worksheet for November 2021

Flow =  $77,695 / 30 \text{ days} = 2,589 \text{ Daily Avg.}$

UV Light =  $119.9 / 22 \text{ Days} = 5.45 \text{ Daily Avg}$

PH – High = 7.80 # 2 Basin – 11/2

PH – Low = 6.23 # 1 Basin – 11/11

D.O. – High = 6.69 # 2 Basin – 11/9

D.O. – Low = 11.77 # 2 Basin – 11/30

Total Nitrogen –  $0.307 + 30.8 = 31.107 / 2 = 15.55 \text{ mg/L}$

Total Suspended Solids -  $< 5 + 5 = 10 / 2 = 5 \text{ mg/L}$

Nitrate/Nitrite –  $0.307 + 30.8 = 31.107 / 2 = 15.55 \text{ mg/L}$


Phosphorus –  $0.12 + 2.8 = 2.92 / 2 = 1.46 \text{ mg/L}$

CBOD -  $< 2.00 + < 2.00 = < 4.00 / 2 = < 2.00 \text{ mg/L}$

Fecal Coliforms -  $< 1 + < 1 = < 2 / 2 = < 1 \text{ MPN/100}$





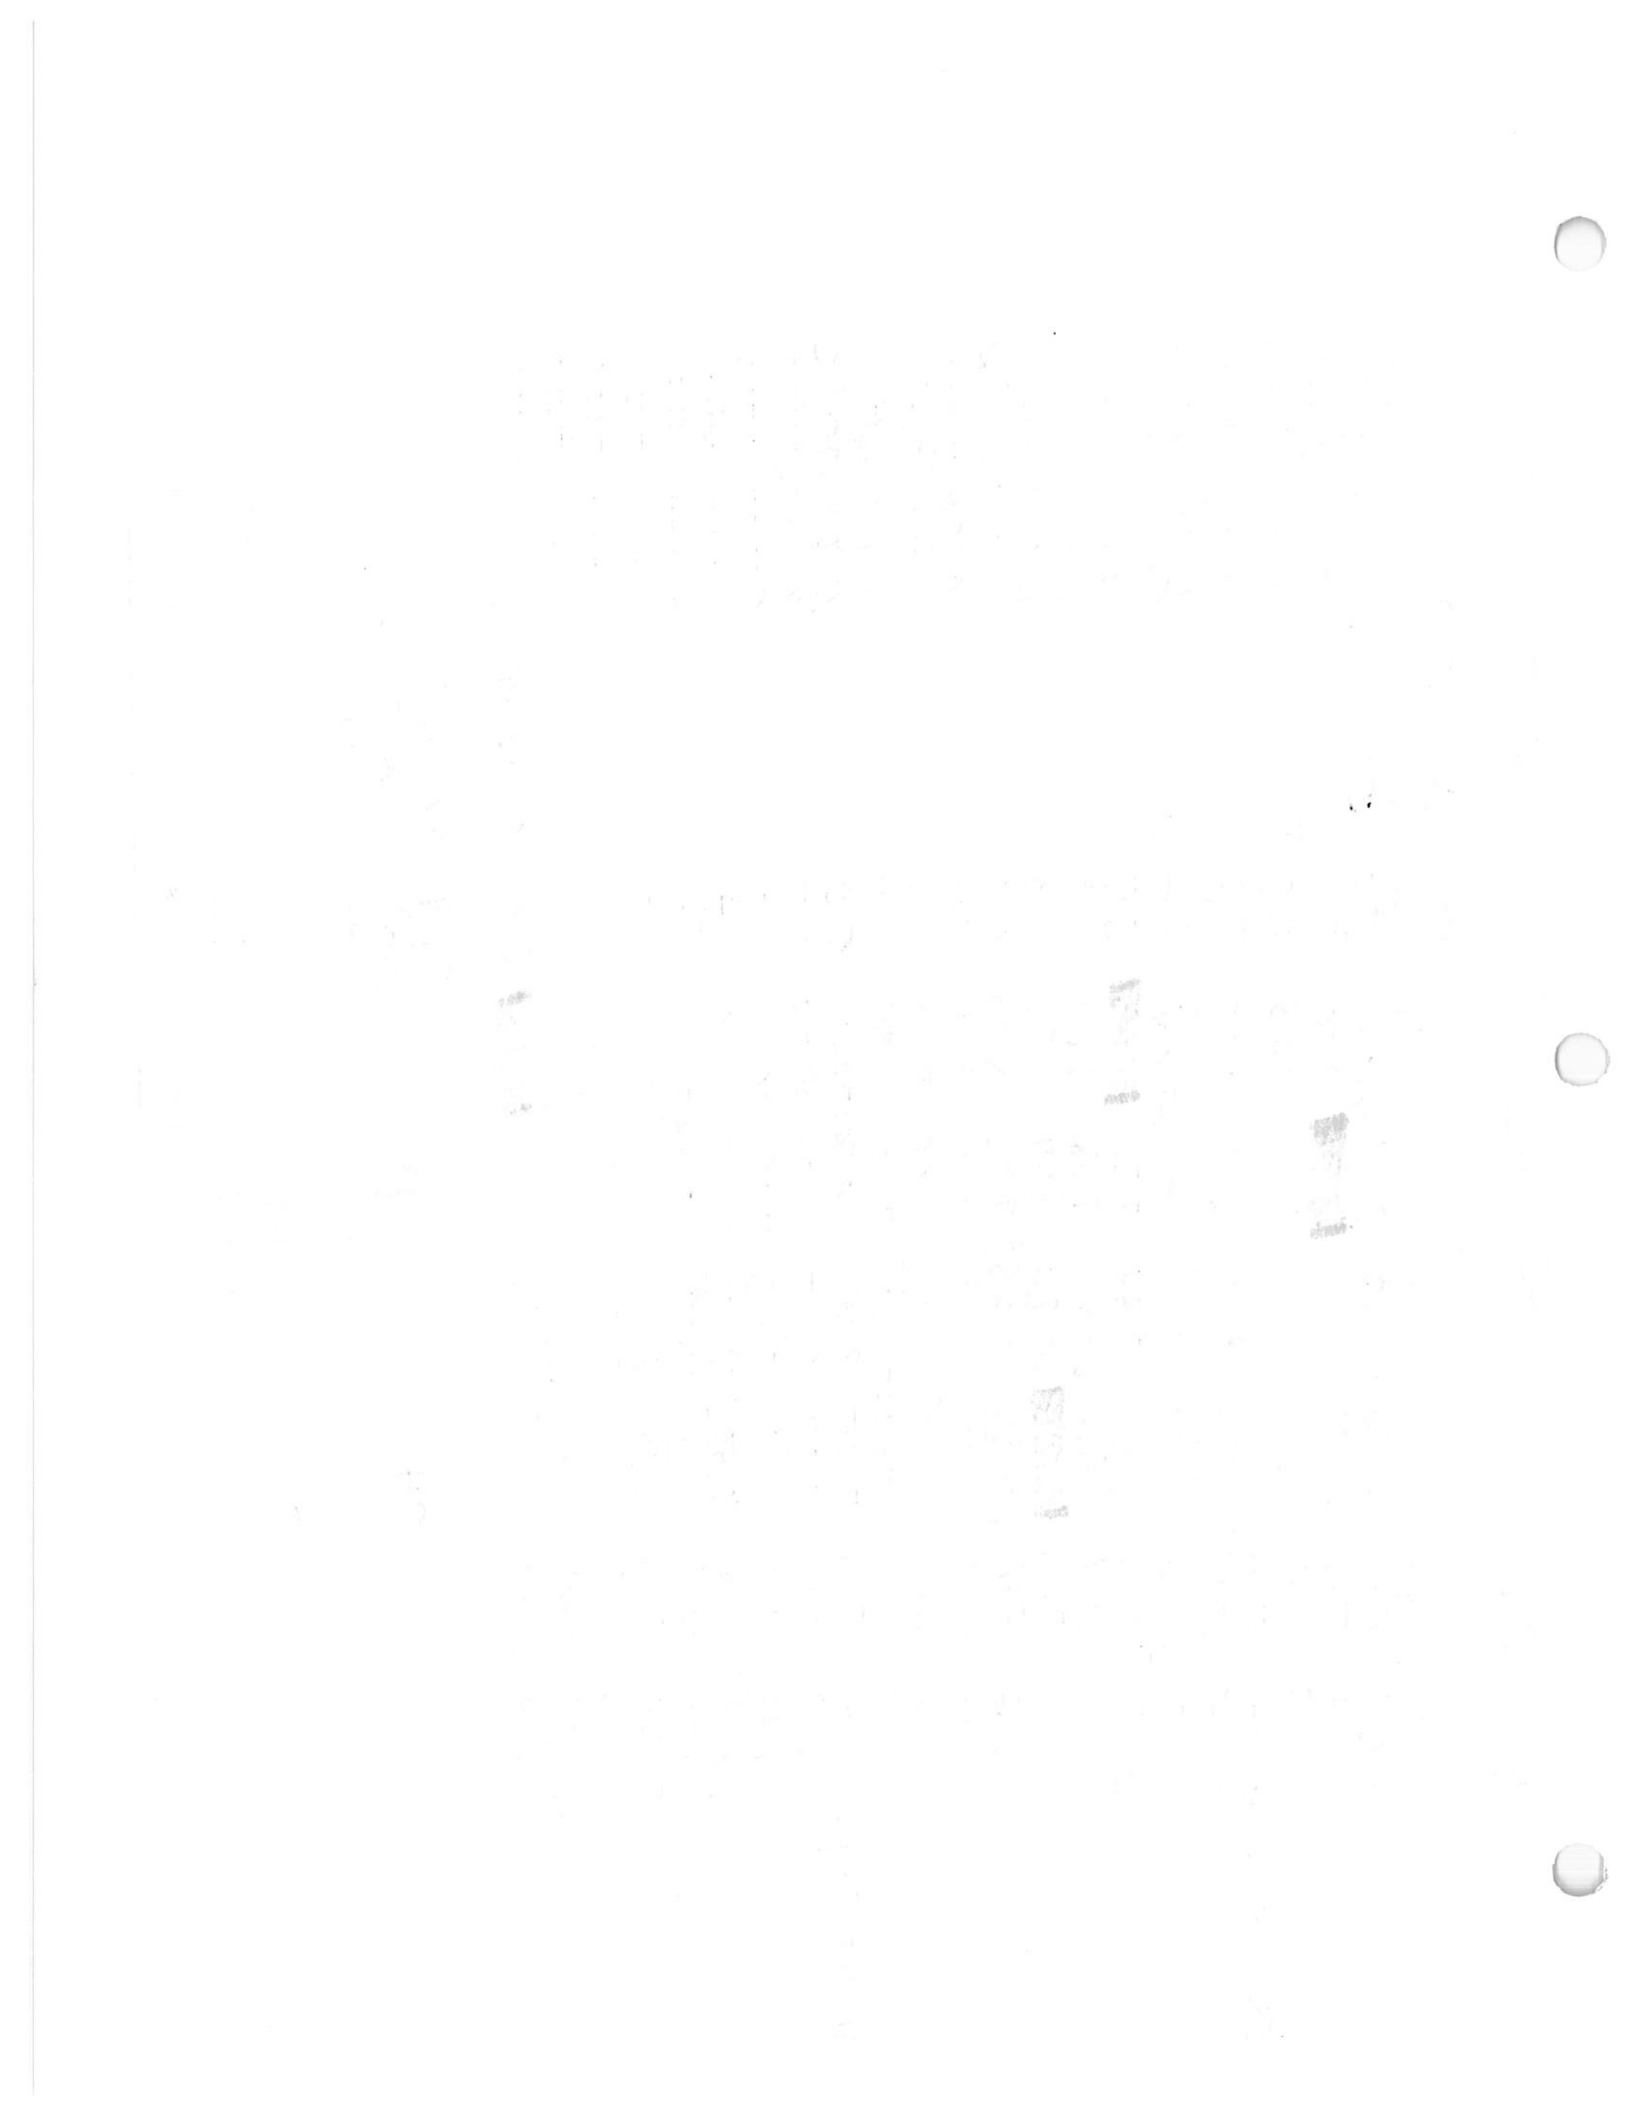

Date	Day	#1 PH	#1 DO	#2 PH	#2 DO	UV	Time	Operator
1-Nov	Monday	6.86	7.28	Aeration	Cycle	5	10:15 AM	Jeff C
2-Nov	Tuesday	6.82	7.35	7.8	7.7	5	5:00 PM	Jeff C
3-Nov	Wednesday	6.77	7.26	7.78	7.63	5	11:30 AM	Jeff C
4-Nov	Thursday	6.62	8.91	7.35	7.72	4.8	10:30 AM	Jeff R
5-Nov	Friday	6.55	8.78	7.35	7.91	5.8	10:45 AM	Jeff R
8-Nov	Monday	6.57	9.5	Aeration	Cycle	6.5	9:00 AM	Jeff C
9-Nov	Tuesday	6.54	9.34	7.2	6.69	5.9	10:30 AM	Jeff R
10-Nov	Wednesday	Aeration	Cycle	7.08	7.64	5.8	11:30 AM	Jeff R
11-Nov	Thursday	6.23	10.73	6.69	9.5	6.3	11:45 AM	Jeff R
12-Nov	Friday	6.35	9.65	7.02	8.93	4.3	1:00 PM	Jeff R
15-Nov	Monday	6.5	9.68	7.05	9.71	5.9	10:00 AM	Jeff C
16-Nov	Tuesday	6.55	9.73	7.09	10.75	6.2	9:00 AM	Jeff C
17-Nov	Wednesday	Aeration	Cycle	7.15	8.35	5.4	3:30 PM	Jeff C
18-Nov	Thursday	7.05	9.15	Aeration	Cycle	5	10:30 AM	Jeff C
19-Nov	Friday	7.08	9.17	7.25	8.02	5.5	4:00 PM	Jeff C
22-Nov	Monday	6.46	9.43	7.18	10.27	5.9	9:00 AM	Jeff C
23-Nov	Tuesday	6.5	9.5	7.2	10.1	5.8	3:30 PM	Jeff C
24-Nov	Wednesday	6.51	9.58	Aeration	Cycle	5.5	8:45 AM	Jeff C
25-Nov	Thursday	6.55	9.62	7.21	9.8	5.2	9:00 AM	Jeff C
26-Nov	Friday	6.56	9.59	7.19	9.68	5.1	7:00 AM	Jeff C
29-Nov	Monday	6.47	10.21	7.31	11.56	5	5:00 PM	Jeff C
30-Nov	Tuesday	6.43	11.52	7.34	11.77	5	7:45 AM	Jeff C





1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

Moniteau School District  
1810 West Sunbury Road  
West Sunbury, PA 16061

Reported: 11/30/2021 14:59

**Lab Sample ID#:** 1111770-01  
**Sample Type:** Waste Water  
**Sample Source:** Grab  
**Sampler:** Client  
**Client Sample ID:** Effluent Grab

**Sample Date:** 11/18/2021 11:00  
**Receipt Date:** 11/18/2021 15:00

Analyte	Sample Result	Units	Data Qualifier	MDL	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>General Chemistry</b>	<b>Analytical Method: ASTMD6919-09</b>					<b>Prep Method: No Prep - WetChem</b>		
Ammonia as N	<0.630	mg/L		0.630	0.800	TLL	11/29/21 18:55	11/29/21 18:55
<b>General Chemistry</b>	<b>Analytical Method: CALC</b>					<b>Prep Method: [CALC]</b>		
Total Nitrogen	0.307	mg/L			0.104	AW	11/29/21 15:02	11/29/21 15:02
<b>General Chemistry</b>	<b>Analytical Method: SM2540 D-11</b>					<b>Prep Method: No Prep - WetChem</b>		
Total Suspended Solids	<5	mg/L			5	LMB	11/22/21 08:55	11/22/21 14:20
<b>General Chemistry</b>	<b>Analytical Method: SM4500-NO3 E-11 (discrete)</b>					<b>Prep Method: No Prep - WetChem</b>		
Nitrate/Nitrite	0.307	mg/L			0.104	AW	11/29/21 15:02	11/29/21 15:02
<b>General Chemistry</b>	<b>Analytical Method: SM4500-P E-11</b>					<b>Prep Method: No Prep - WetChem</b>		
Phosphorus	0.12	mg/L			0.10	AW	11/29/21 14:30	11/29/21 14:30
<b>General Chemistry</b>	<b>Analytical Method: SM5210 B-11</b>					<b>Prep Method: No Prep - WetChem</b>		
Carbonaceous Biochemical Oxygen Demand	<2.00	mg/L	BB, SS		2.00	JAW	11/18/21 17:40	11/23/21 12:50
<b>Microbiology</b>	<b>Analytical Method: Colilert-18</b>					<b>Prep Method: No Prep - Micro</b>		
Fecal Coliforms	<1	MPN/100 mL			1	KD	11/18/21 15:00	11/19/21 11:15







1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpsville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

30 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

**Work Order: 1111770**  
**Project: Wastewater**  
**Project Description: Wastewater**

## Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
Effluent Grab	1111770-01	Waste Water	11/18/2021 11:00	11/18/21 15:00	

### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

### Definitions

SS Seed Control did not meet reference method acceptance criteria.  
 BB Dilution water blank exceeded method acceptance criteria of 0.20 mg/L DO loss.  
 RL Reporting Limit  
 CFU Colony Forming Units  
 MDL Method Detection Limit

### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.  
 Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

Approved By







1803 Philadelphia Street  
 Indiana, PA 15701  
 P: (724) 463-8378  
 F: (724) 465-4209  
 PADEP: 32-00382

1276 Bentleyville Road  
 Van Voorhis, PA 15366  
 P: (724) 258-8378  
 F: (724) 258-8376  
 PADEP: 63-04247

435 Broad Street  
 Montoursville, PA 17754  
 P: (570) 321-9002  
 F: (570) 321-1957  
 PADEP: 41-04880

950 West Main Street  
 Sharpville, PA 16150  
 P: (724) 463-8378 x 500  
 F: (724) 465-4209  
 PADEP: 43-04934

Moniteau School District  
 1810 West Sunbury Road  
 West Sunbury, PA 16061

Reported: 11/17/2021 06:33

**Lab Sample ID#:** 1110506-01  
**Sample Type:** Waste Water  
**Sample Source:** Grab  
**Sampler:** Jeffrey Campbell  
**Client Sample ID:** Effluent Grab

**Sample Date:** 11/04/2021 11:00  
**Receipt Date:** 11/04/2021 15:00

Analyte	Sample Result	Units	Data Qualifier	RL	Analyst/ Certification	Prep Date/Time	Analysis Date/Time
<b>General Chemistry</b>	<b>Analytical Method: CALC</b>				<b>Prep Method: [CALC]</b>		
Total Nitrogen	30.8	mg/L		1.66	AW	11/15/21 11:56	11/15/21 17:45
<b>General Chemistry</b>	<b>Analytical Method: SM2540 D-11</b>				<b>Prep Method: No Prep - WetChem</b>		
Total Suspended Solids	5	mg/L		5	LMB	11/09/21 11:04	11/09/21 14:00
<b>General Chemistry</b>	<b>Analytical Method: SM4500 NH3 F-11</b>				<b>Prep Method: SM 4500-Norg B</b>		
Total Kjeldahl Nitrogen	<0.625	mg/L		0.625	AW	11/14/21 07:45	11/15/21 17:45
<b>General Chemistry</b>	<b>Analytical Method: SM4500-NO3 E-11 (discrete)</b>				<b>Prep Method: No Prep - WetChem</b>		
Nitrate/Nitrite	30.8	mg/L		1.04	AW	11/15/21 11:56	11/15/21 15:44
<b>General Chemistry</b>	<b>Analytical Method: SM4500-P E-11</b>				<b>Prep Method: No Prep - WetChem</b>		
Phosphorus	2.8	mg/L		0.50	DAA	11/11/21 16:00	11/11/21 17:25
<b>General Chemistry</b>	<b>Analytical Method: SM5210 B-11</b>				<b>Prep Method: No Prep - WetChem</b>		
Carbonaceous Biochemical Oxygen Demand	<2.00	mg/L	SS	2.00	AS	11/05/21 14:55	11/10/21 09:30
<b>Microbiology</b>	<b>Analytical Method: Colilert-18</b>				<b>Prep Method: No Prep - Micro</b>		
Fecal Coliforms	<1	MPN/100 mL		1	KD	11/04/21 15:25	11/05/21 09:52



1803 Philadelphia Street  
Indiana, PA 15701  
P: (724) 463-8378  
F: (724) 465-4209  
PADEP: 32-00382

1276 Bentleyville Road  
Van Voorhis, PA 15366  
P: (724) 258-8378  
F: (724) 258-8376  
PADEP: 63-04247

435 Broad Street  
Montoursville, PA 17754  
P: (570) 321-9002  
F: (570) 321-1957  
PADEP: 41-04880

950 West Main Street  
Sharpville, PA 16150  
P: (724) 463-8378 x 500  
F: (724) 465-4209  
PADEP: 43-04934

17 November 2021

Moniteau School District  
Attn: Jeffrey Campbell  
1810 West Sunbury Road  
West Sunbury, PA 16061

**Work Order: 1110506**  
**Project: Wastewater**  
**Project Description: Wastewater**

### Report of Analysis

Client Sample ID	Lab Sample ID	Matrix	Date Sampled	Date Received	Sample Notes
Effluent Grab	1110506-01	Waste Water	11/04/2021 11:00	11/4/21 15:00	

#### Report Narrative

The results contained in this report are only representative of the samples received. Environmental Service Laboratories, Inc. is not responsible for use or interpretation of the data included herein.

#### Definitions

- SS Seed Control did not meet reference method acceptance criteria.
- RL Reporting Limit
- CFU Colony Forming Units

#### Certifications

Analyses performed by Environmental Service Laboratories, Inc., Indiana PA unless otherwise specified.  
Environmental Service Laboratories, Inc., Indiana, PA/TNI Certification #32-00382

#### Approved By

Rebecca Erwin  
Client Services Manager







### SAMPLE RECEIPT AND REVIEW FORM



Client: <u>Monitree</u>	Work Order: _____
-------------------------	-------------------

#### PART A: GENERAL INFORMATION- SATELLITE LABORATORY

Received by/Lab ID: _____	Date/Time Received: / / _____
Method of Delivery: Client Drop-Off <input type="checkbox"/> ESL Courier <input type="checkbox"/> Other: _____	Received on Ice? YES <input type="checkbox"/> NO <input type="checkbox"/>
Sample Receipt Temperature: _____ °C	IR Gun ID: _____
Containers Removed by Satellite Lab for Analysis of: FECAL <input type="checkbox"/> TC/EC <input type="checkbox"/> TC MPN <input type="checkbox"/> EC MPN <input type="checkbox"/> TC/EC MPN <input type="checkbox"/> N/A <input type="checkbox"/>	

#### PART B: GENERAL INFORMATION- INDIANA LABORATORY

Received by/Lab ID: <u>SPM (00382)</u>	Samples Received on Ice? <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
Date/Time Received: <u>11/4/12 1:50pm</u>	Date Sampled: <u>11/4/12</u>
Method of Delivery: FedEx <input type="checkbox"/> UPS <input type="checkbox"/> Client Drop off <input type="checkbox"/> <input checked="" type="checkbox"/> ESL courier <input type="checkbox"/> Other: _____	
Sample Receipt Temperature: <u>31</u> °C	IR Gun ID: <u>3</u>
Sample State of Collection: <input checked="" type="checkbox"/> PA <input type="checkbox"/> NY <input type="checkbox"/> OH <input type="checkbox"/> WV <input type="checkbox"/> Other: _____	PWSID Compliance Drinking Water Samples: YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>

#### PART C: Receipt Details Completed (if different from above): \_\_\_\_\_

Sample Receipt Criteria			Signature	Date	Time
	YES	NO			
Chain of custody documents included with samples?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Sample containers intact and sealed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Number of containers received matches number indicated on COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Sample IDs on COC match IDs on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Date and time on COC match date and time on bottles?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Samples received within holding time?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Samples received at appropriate pH for analysis requested?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Samples requiring thermal preservation within 0 ≤ 6°C? Microbiology within 0 ≤ 10°C?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Adequate sample volume received?	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
VOA vials free of headspace (defined as < 6 mm bubble)?	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>			
Other Comments:			Deficiency Log Created:		
			YES <input type="checkbox"/> NO <input checked="" type="checkbox"/>		

Effective Date: \_\_\_\_\_